

June 2025

Legend

- Municipal Boundary
- Parcels In City

Town of Loxahatchee Groves



Resilient Florida Surface Water Management System Assessment

2025 10Y-3D Simulation


Depth of Maximum Water

Rainfall (in.) = 10.0
Sea Level Rise (ft.) = 0.0


Depth (ft)	
0	1.5 - 2.0
0 - 0.5	2.0 - 2.5
0.5 - 1.0	3.0 - 3.5
1.0 - 1.5	3.5 - 4.0
1.5 - 2.0	4.0 - 4.5
2.0 - 2.5	4.5 - 5.0
2.5 - 3.0	>5

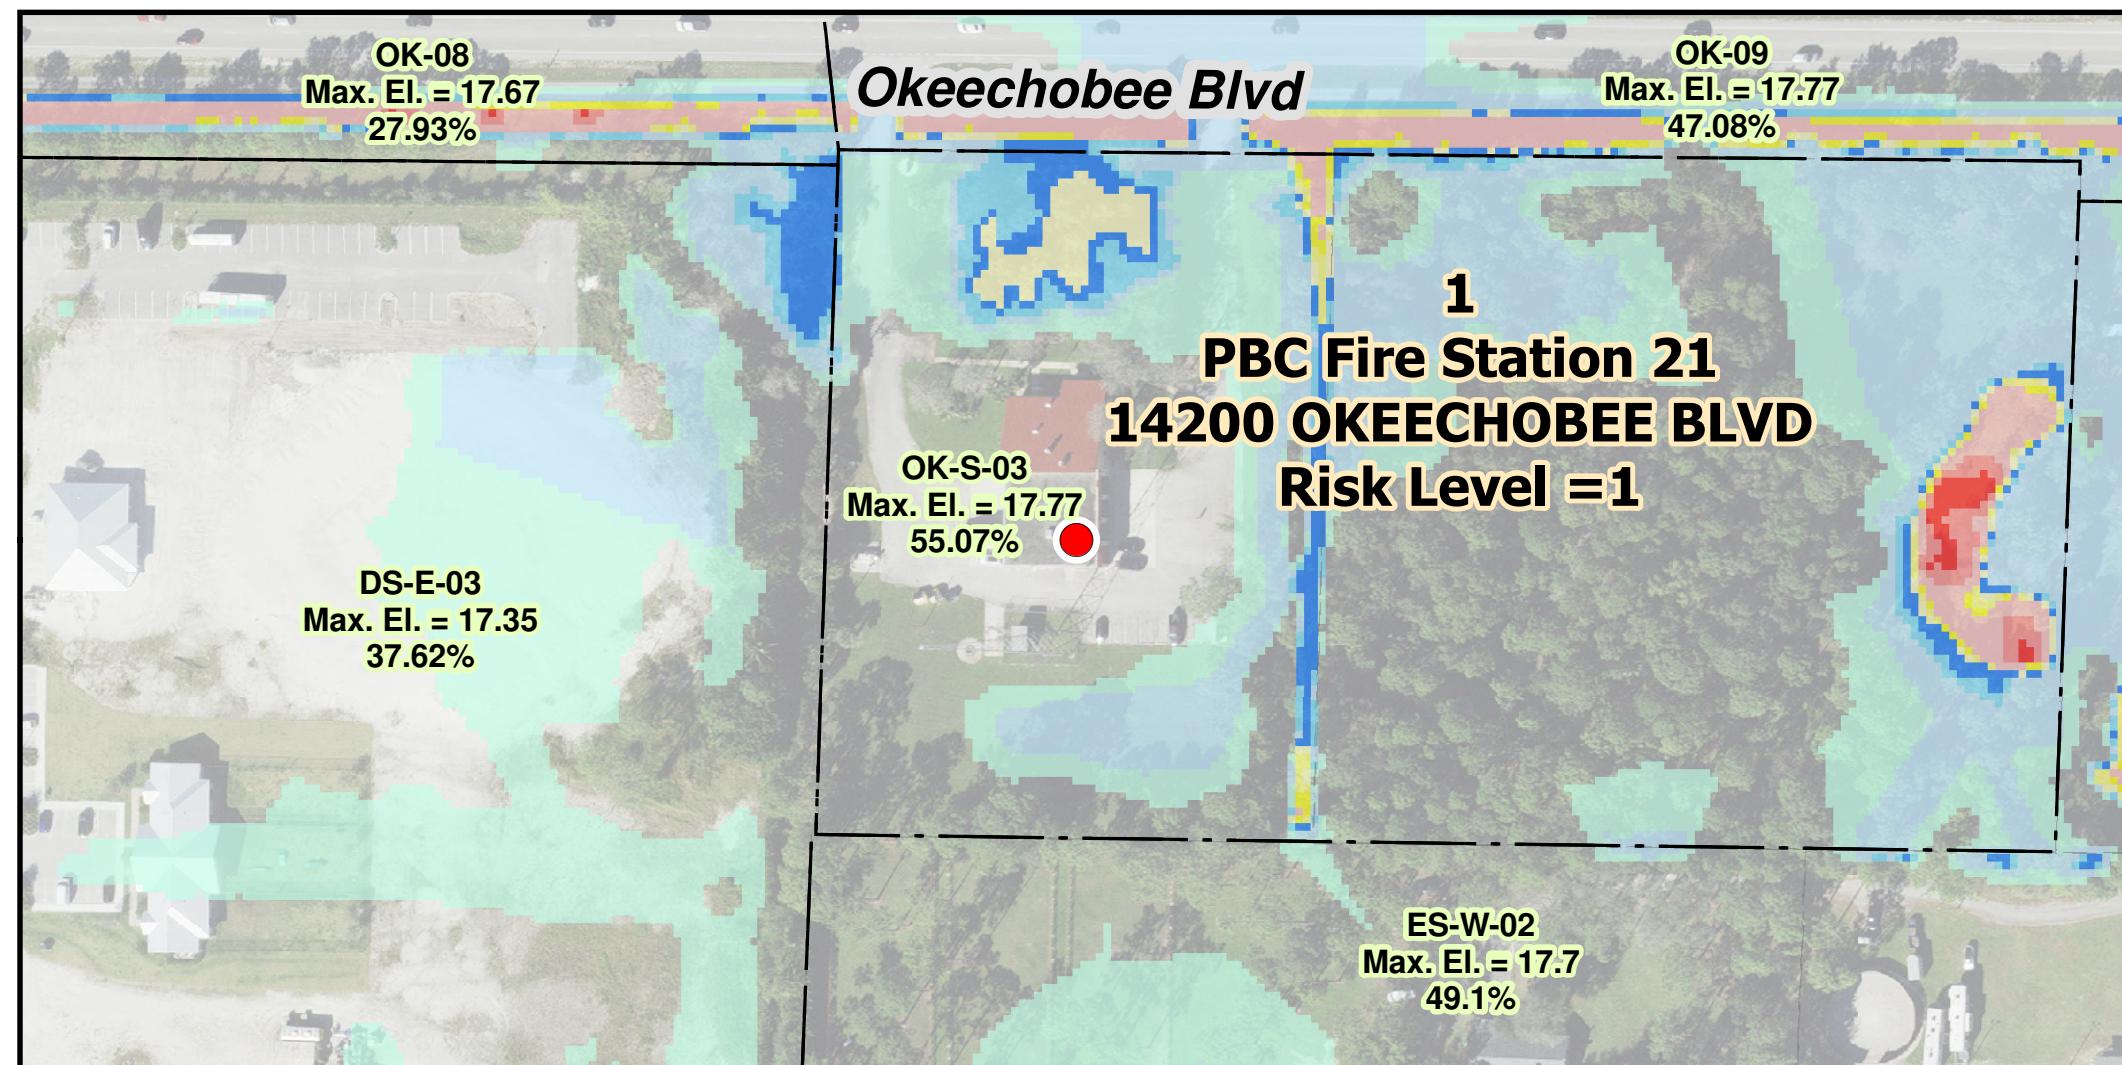


Critical Asset No. 1
Palm Beach County Fire Station

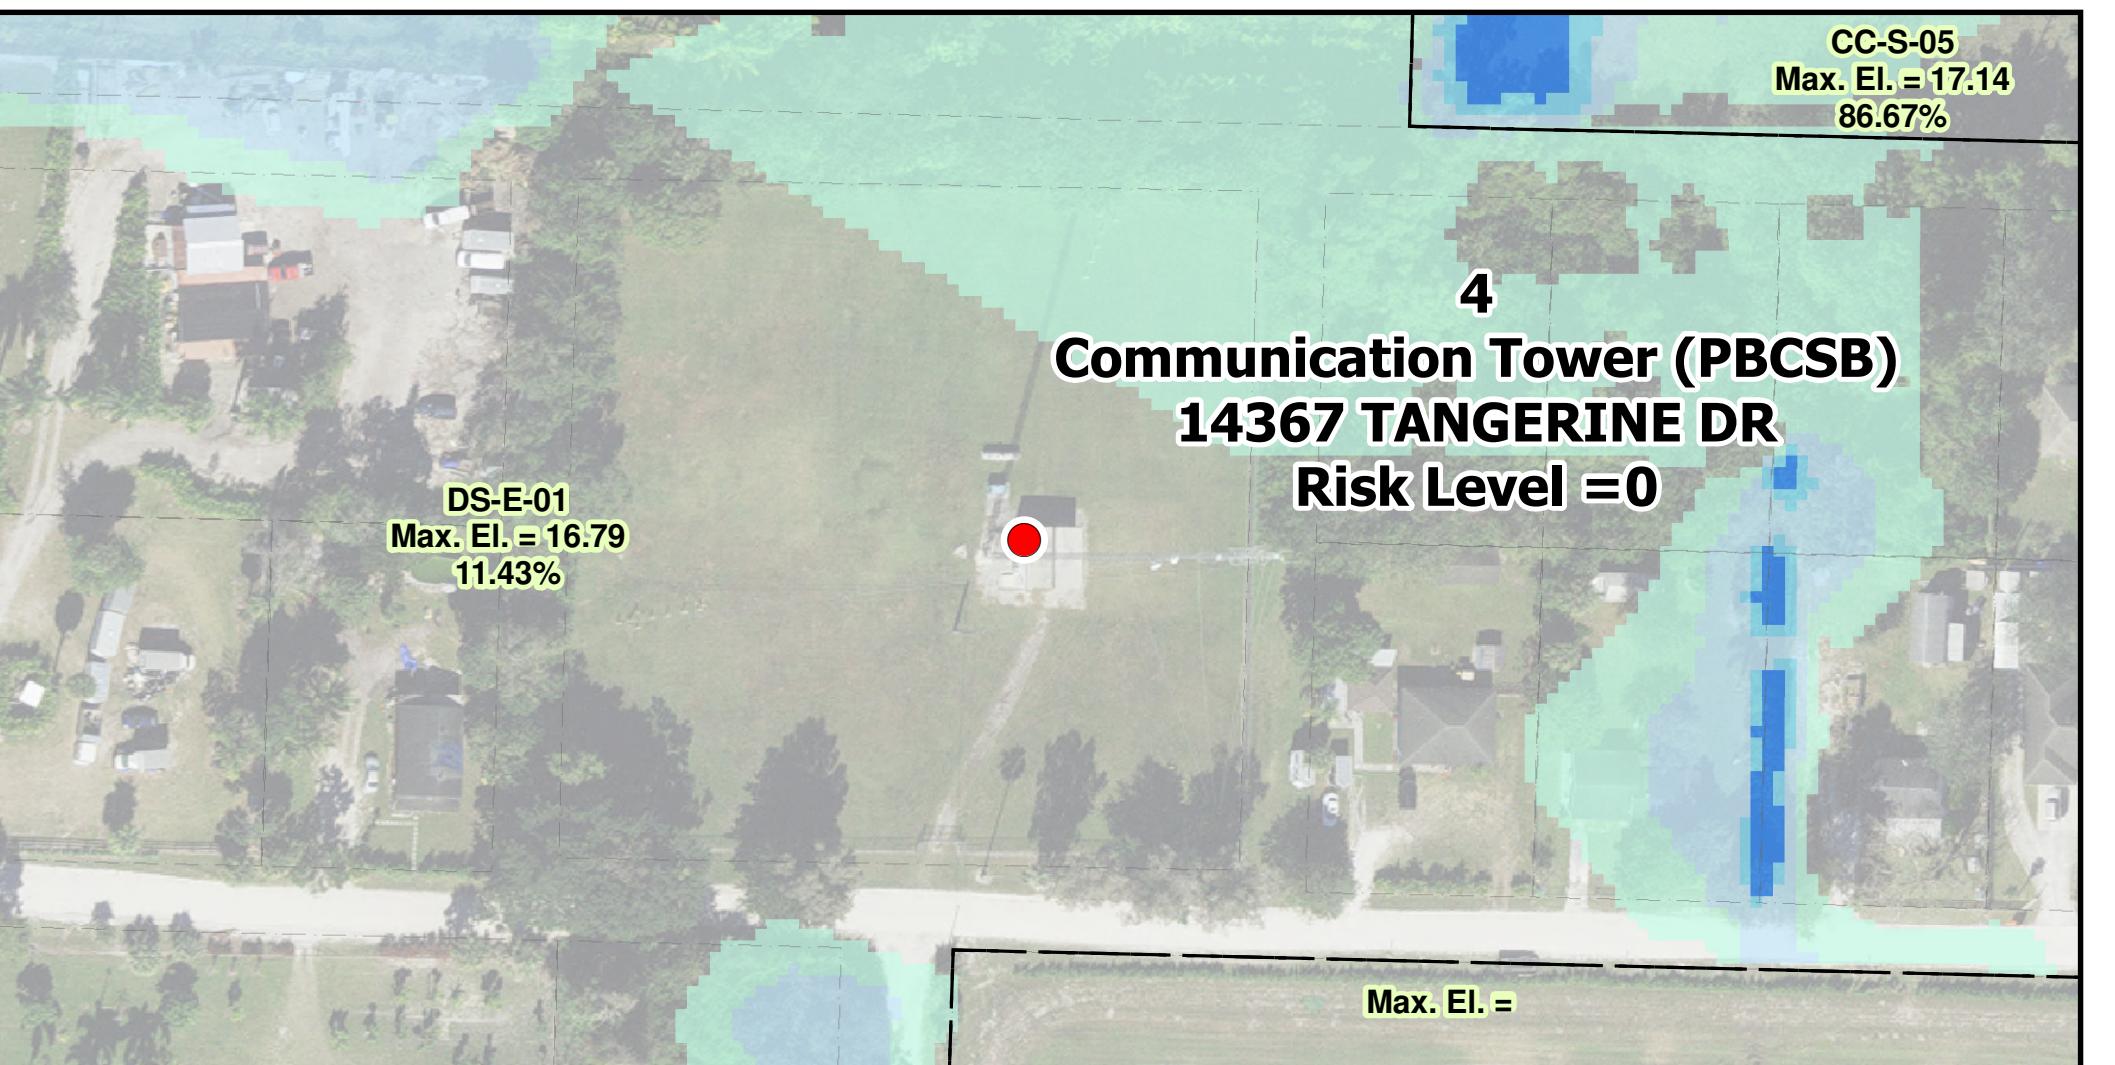


Critical Asset No. 4
Palm Beach County School Board Communications Tower

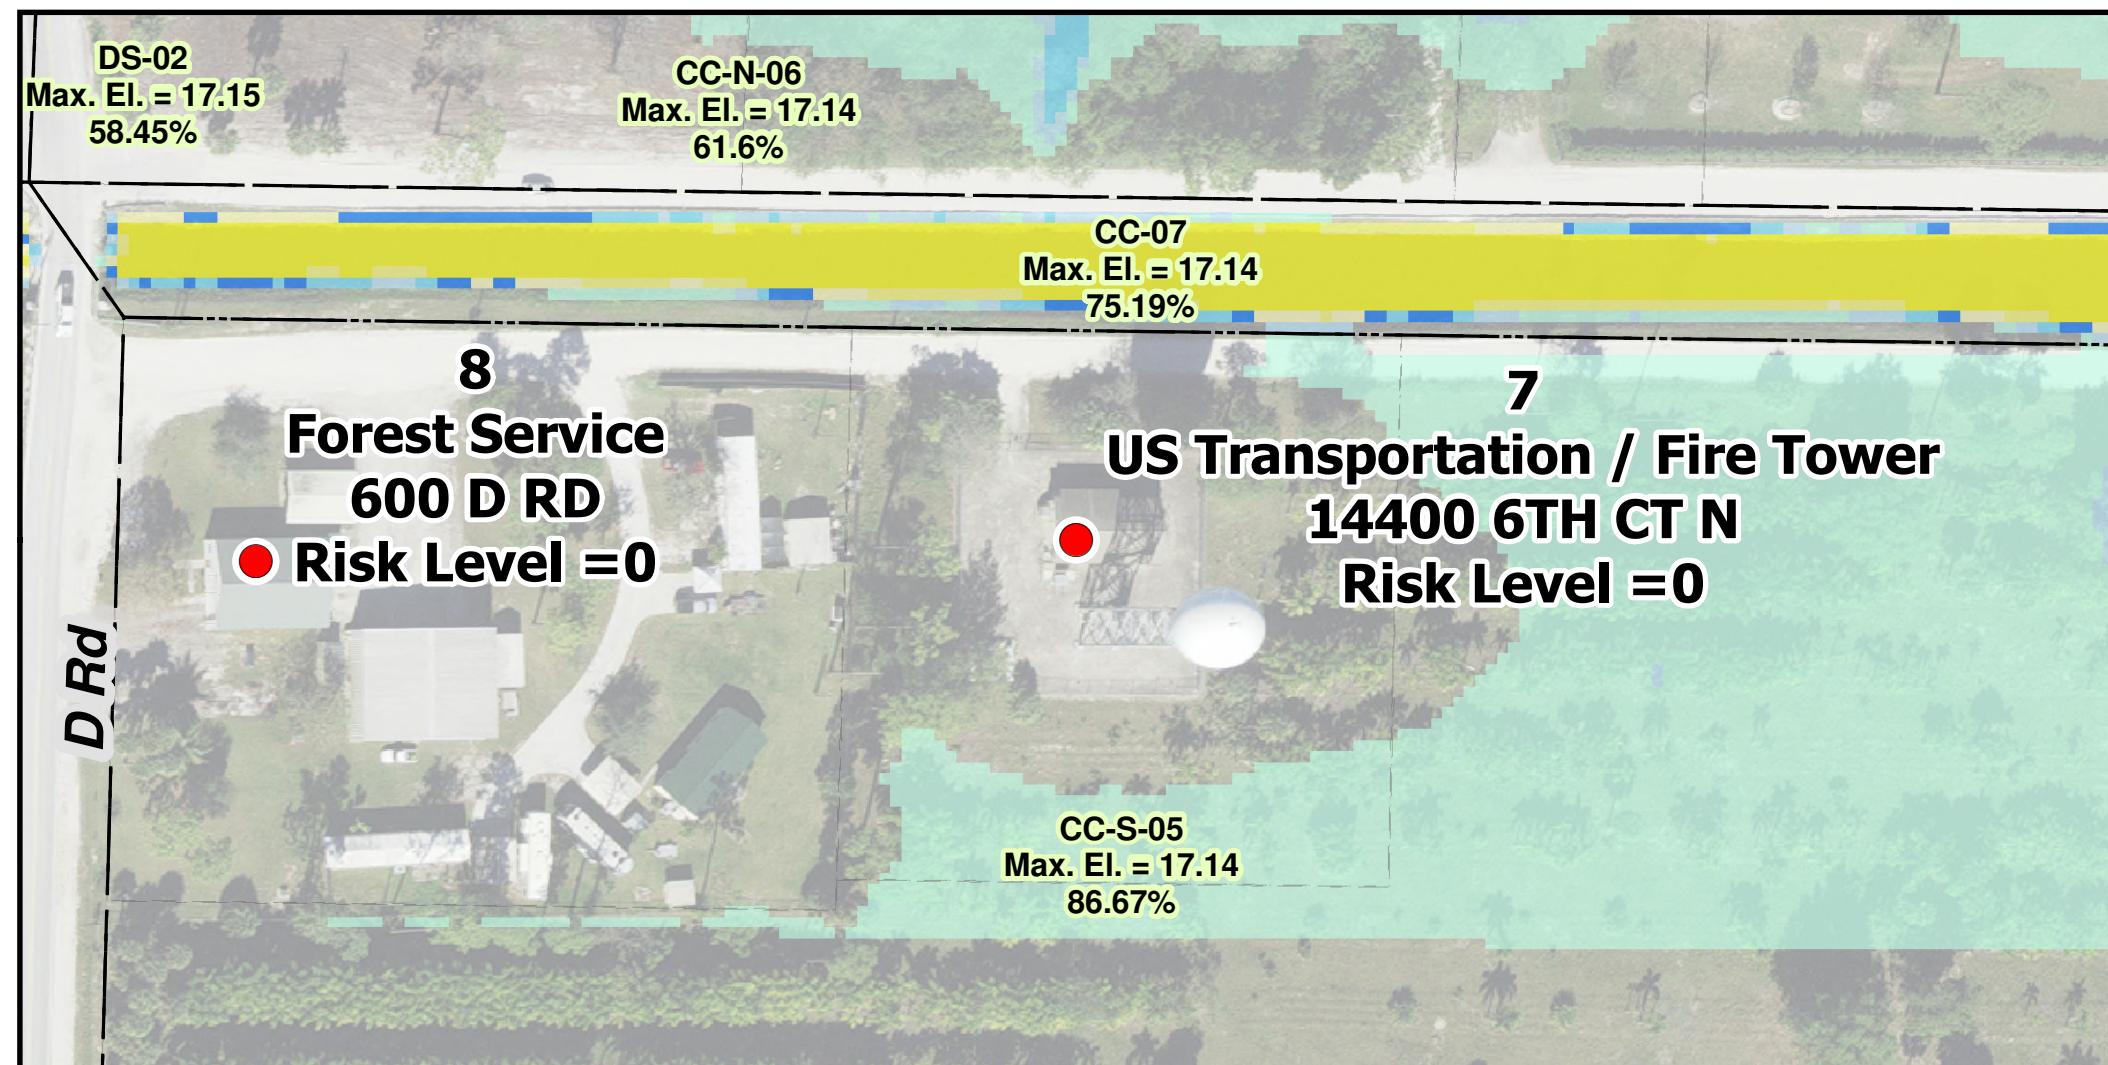

Critical Asset No. 7
US Department of Transportation / Fire Tower

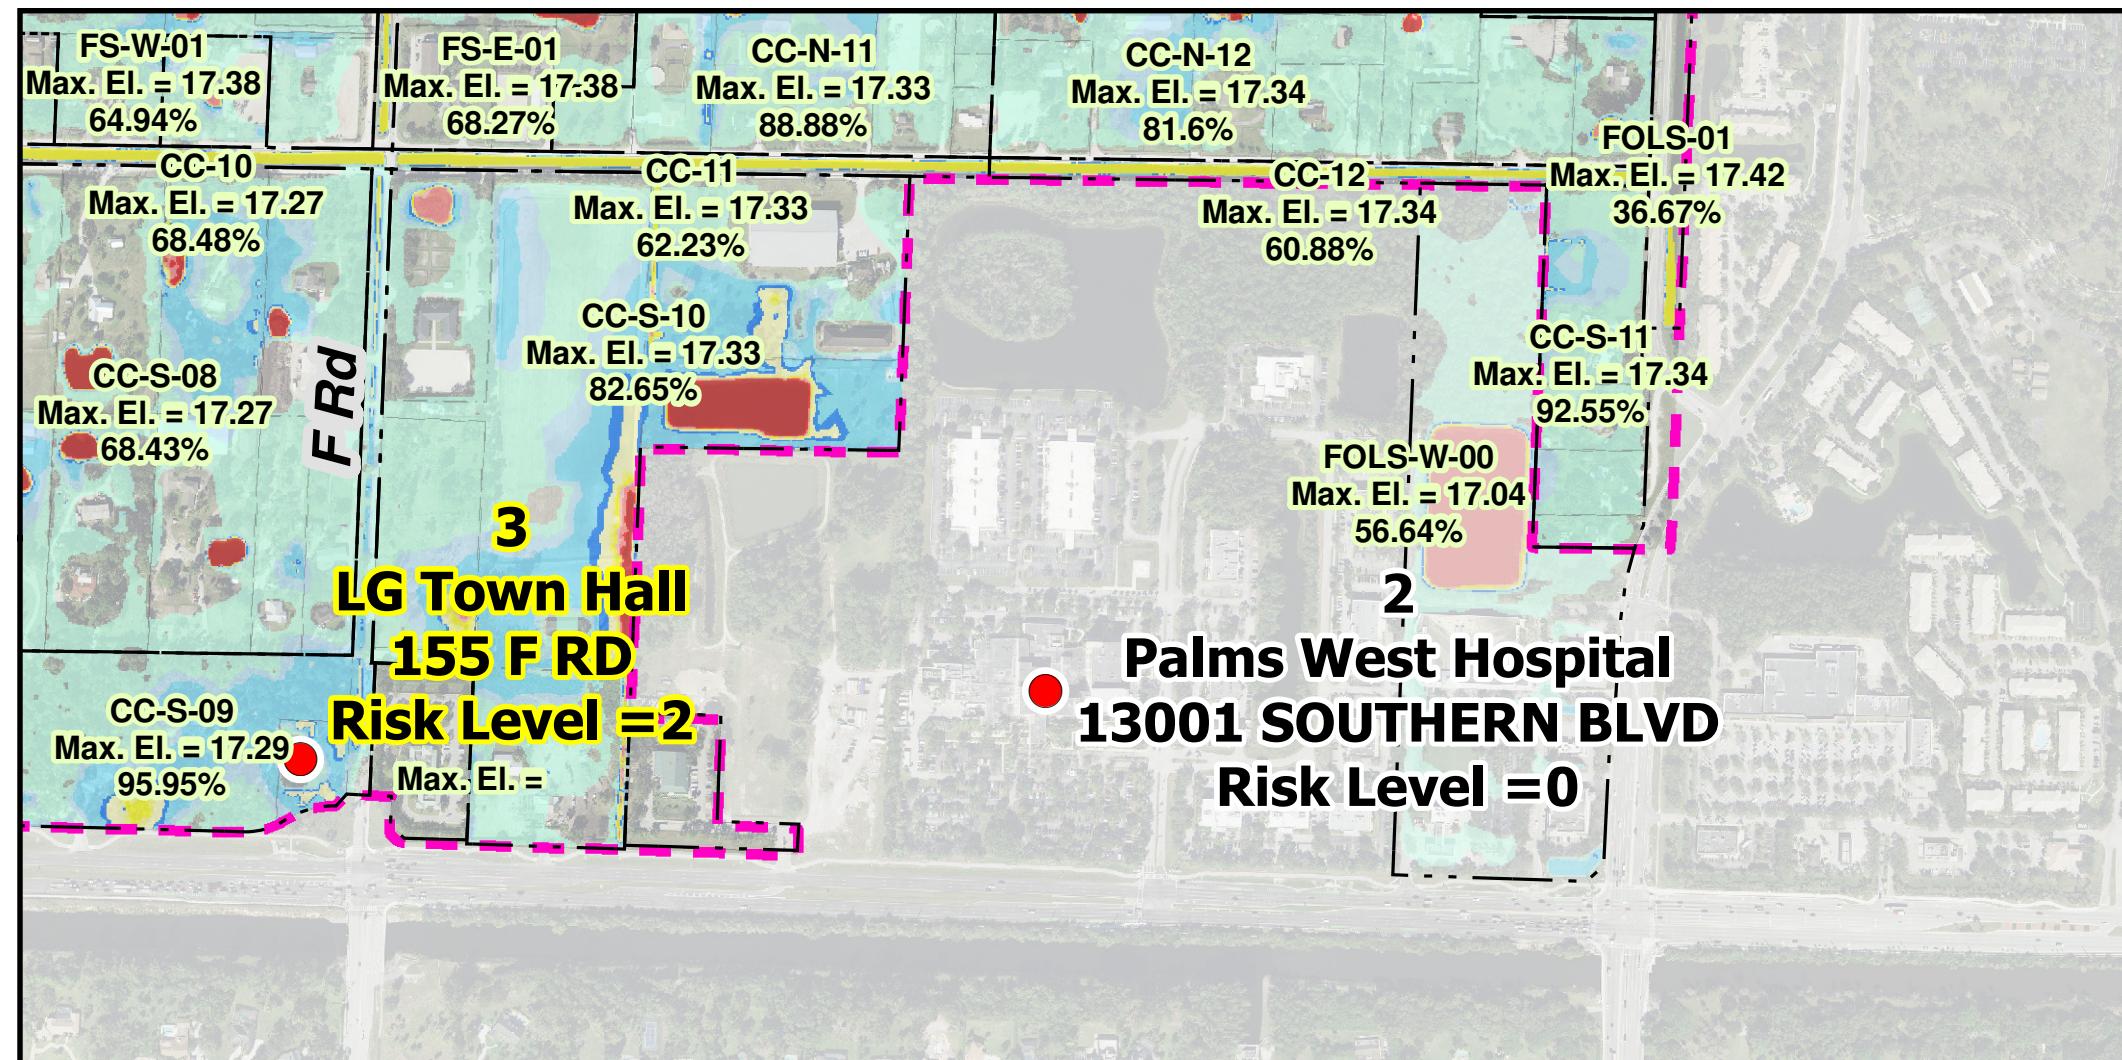


Critical Asset No. 2
Palms West Hospital

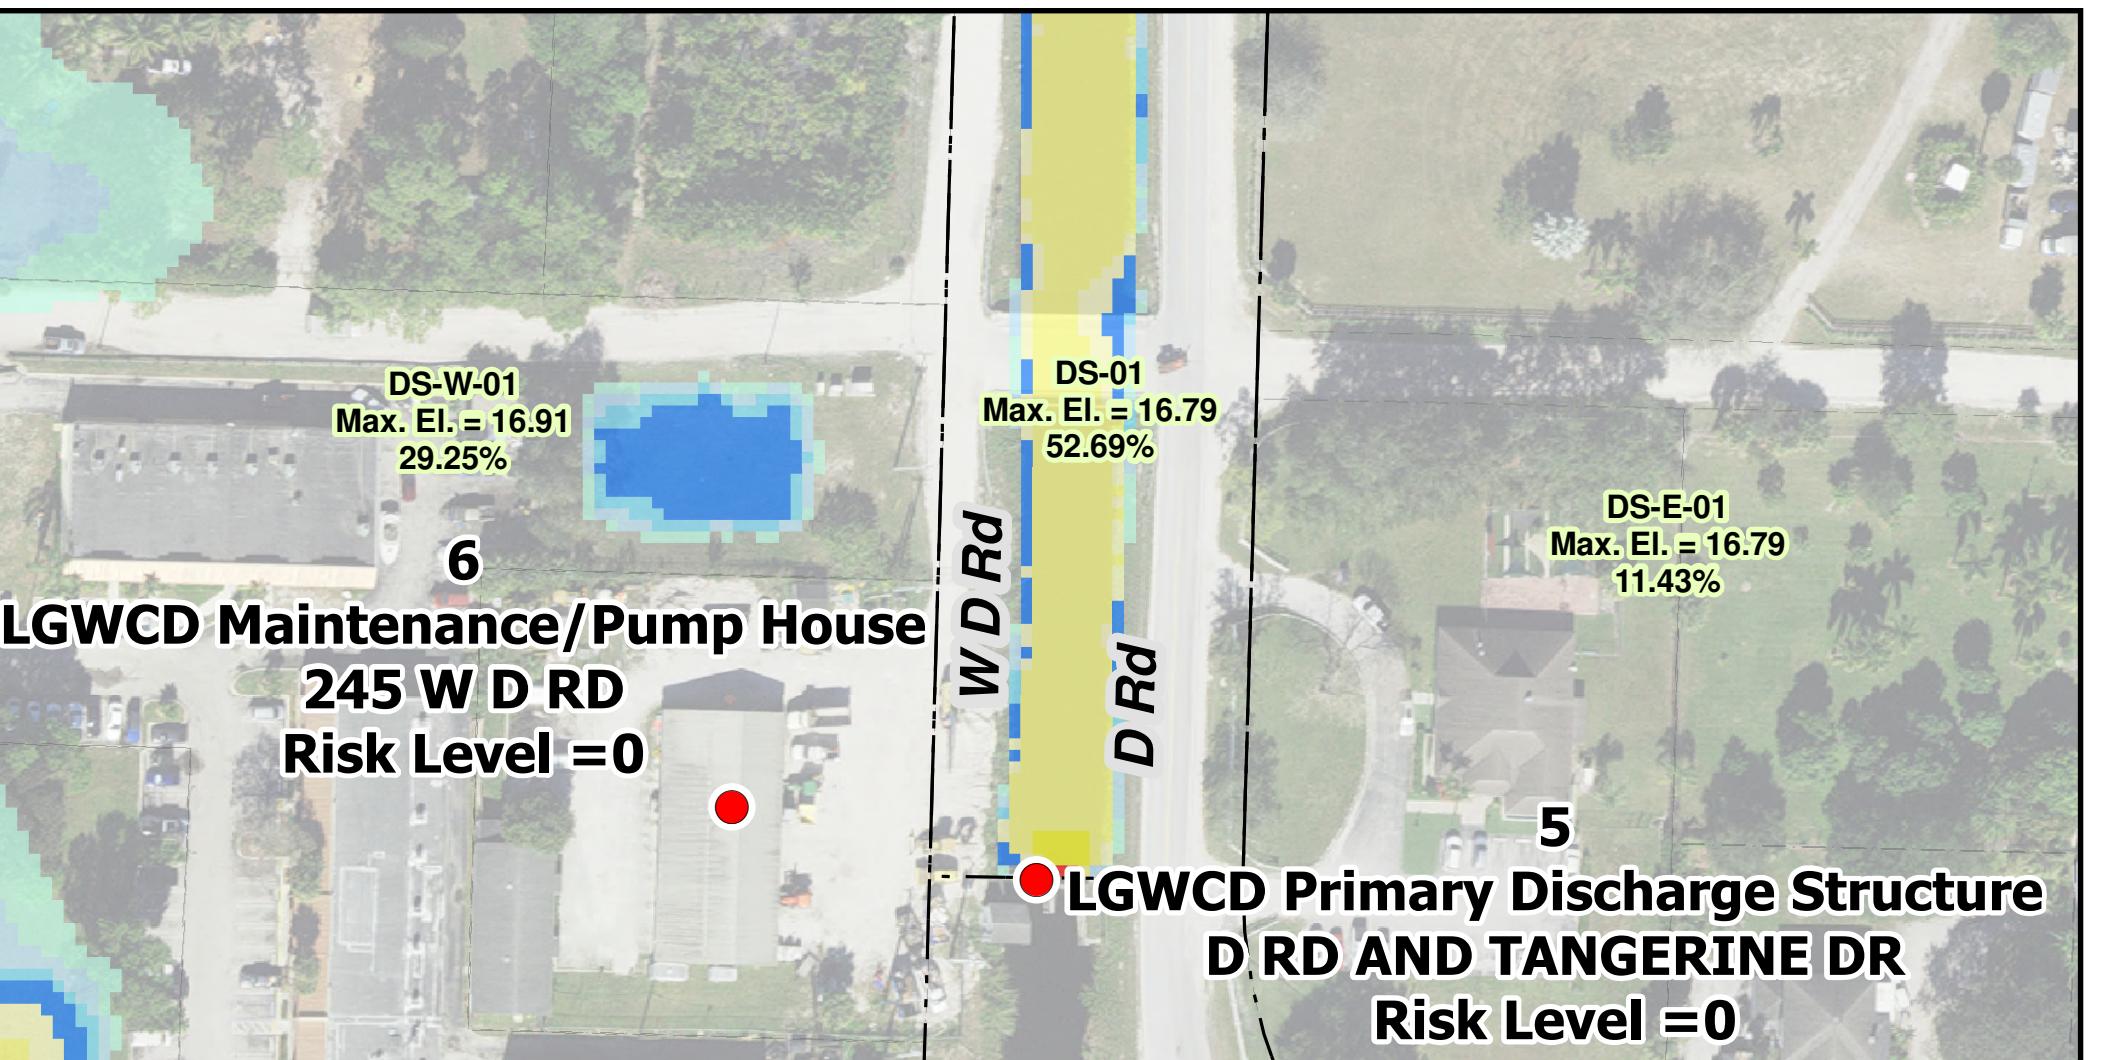


Critical Asset No. 5
Primary Storm Discharge Structure




Critical Asset No. 8
Forest Service

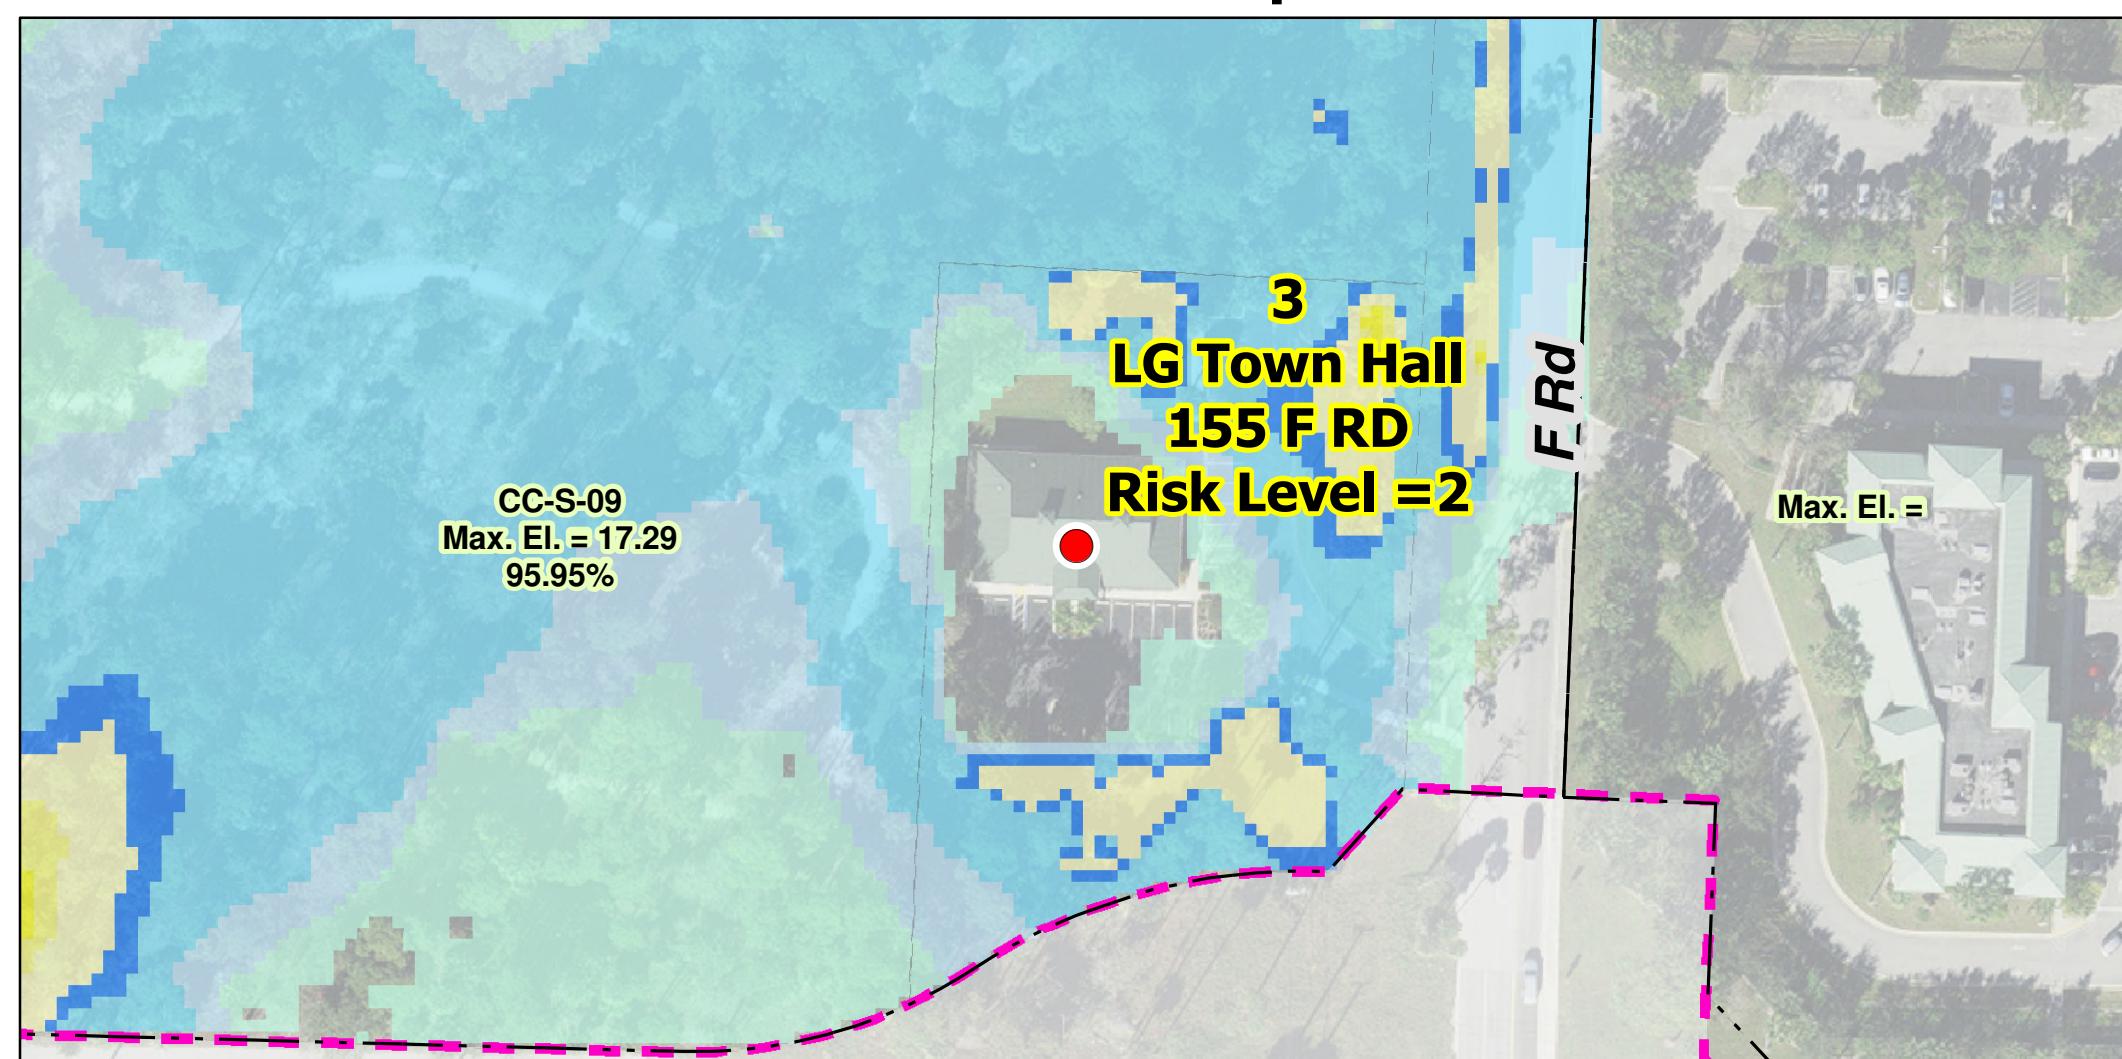

Critical Asset No. 3
Town Hall

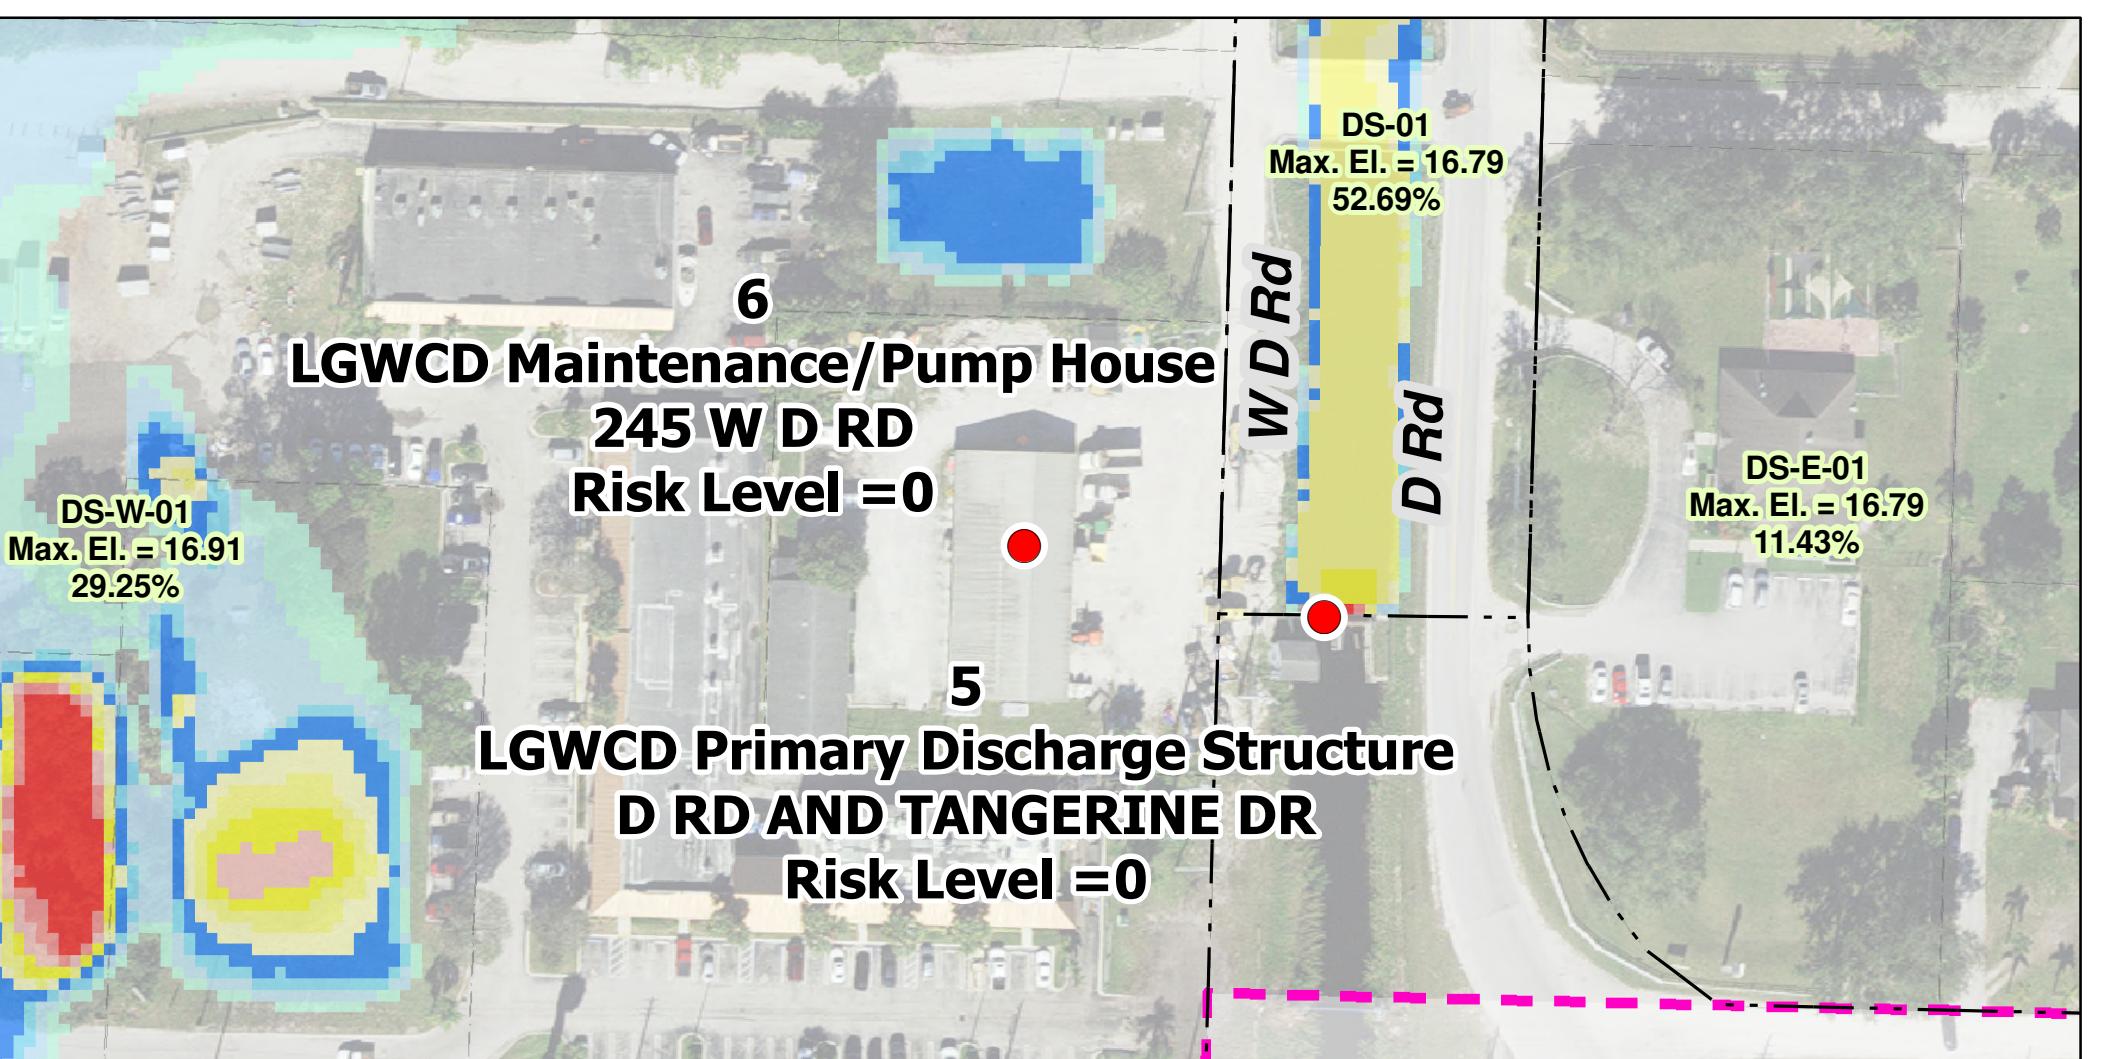

Critical Asset No. 6
Maintenance Operations Building & Pump House

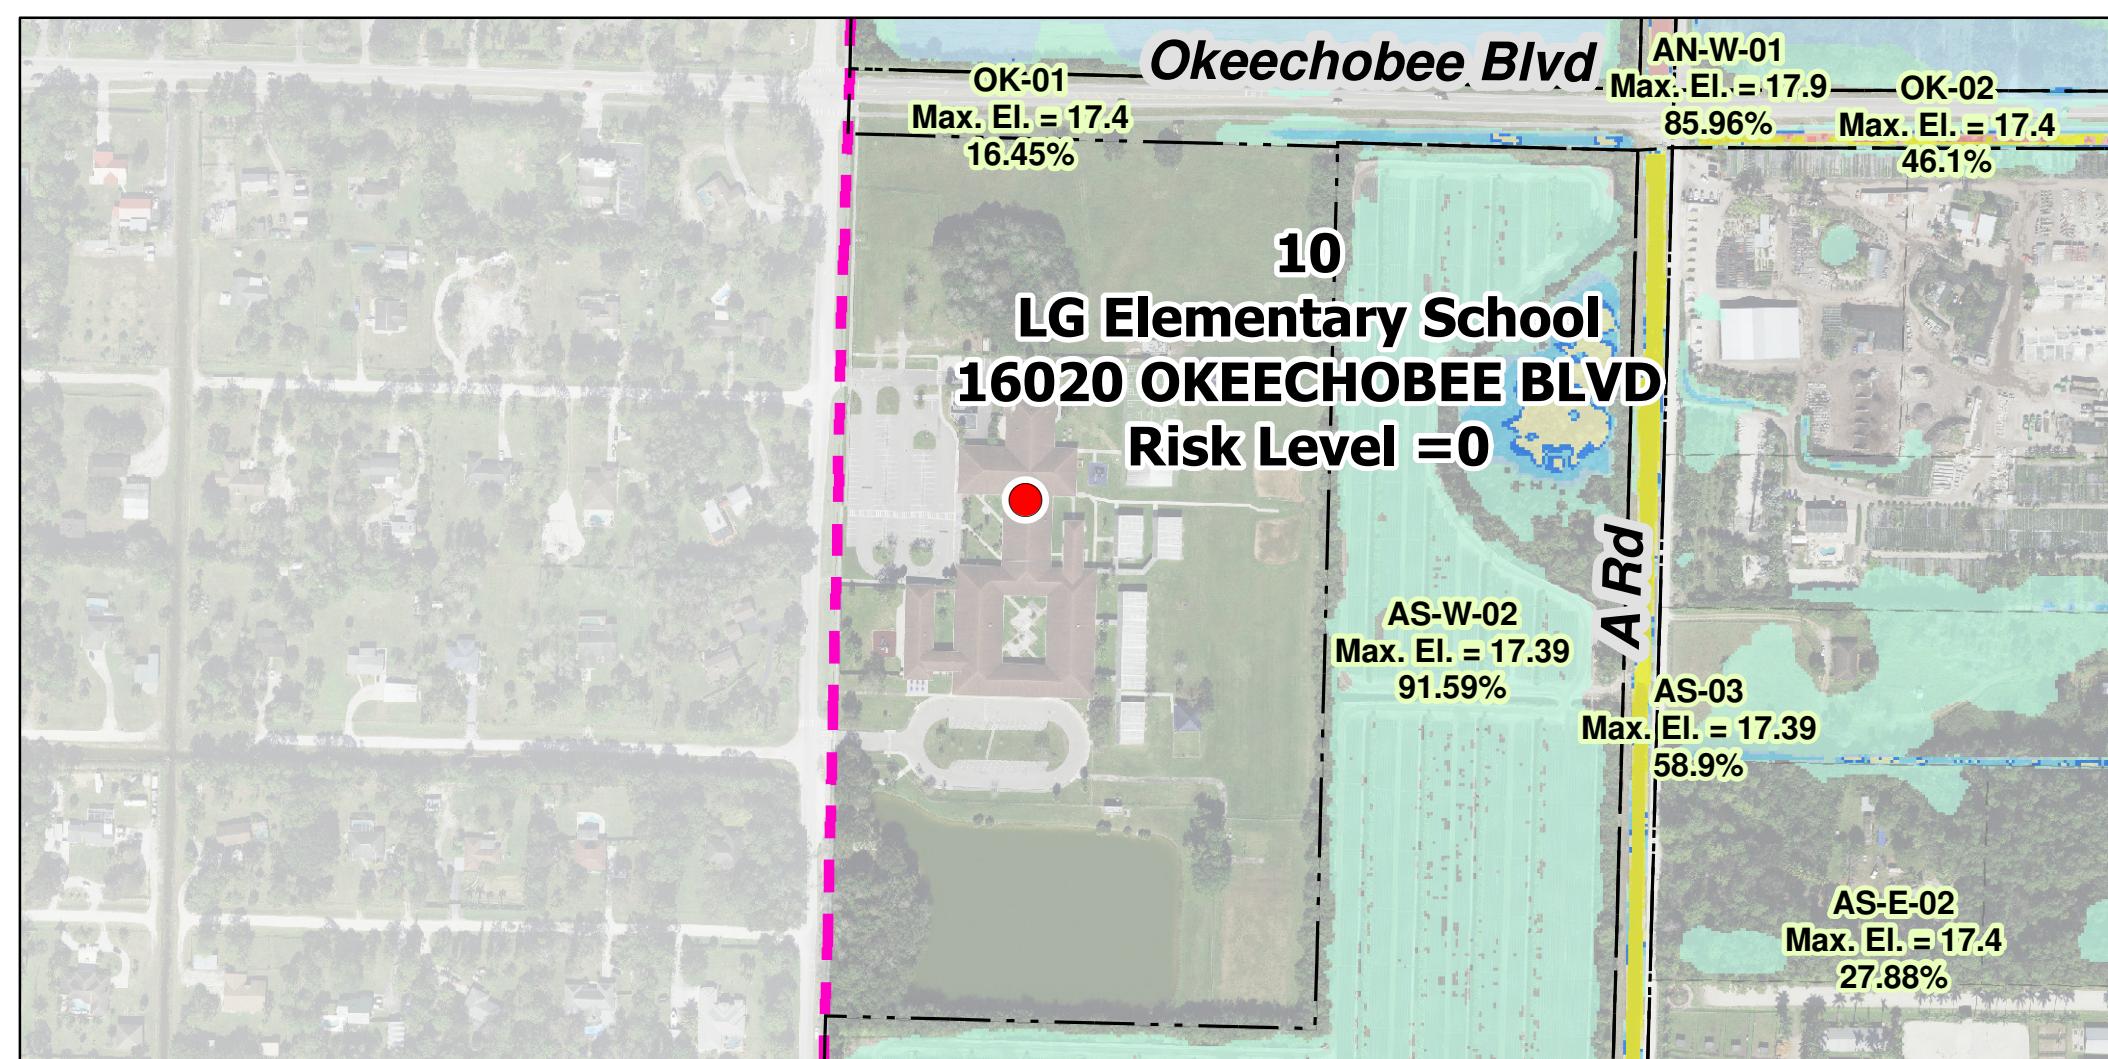

Critical Asset No. 10
Elementary School