

June 2025

### Legend



- Municipal Boundary
- Parcels In City

# Town of Loxahatchee Groves Resilient Florida Surface Water Management System Assessment 2025 100Y-3D Simulation Depth of Maximum Water


Rainfall (in.) = 17.0  
Sea Level Rise (ft.) = 0.0

### Depth (ft)


0	1.5 - 2.0	3.5 - 4.0
0 - 0.5	2.0 - 2.5	4.0 - 4.5
0.5 - 1.0	3.5 - 3.0	4.5 - 5.0
1.0 - 1.5	3.0 - 3.5	>5

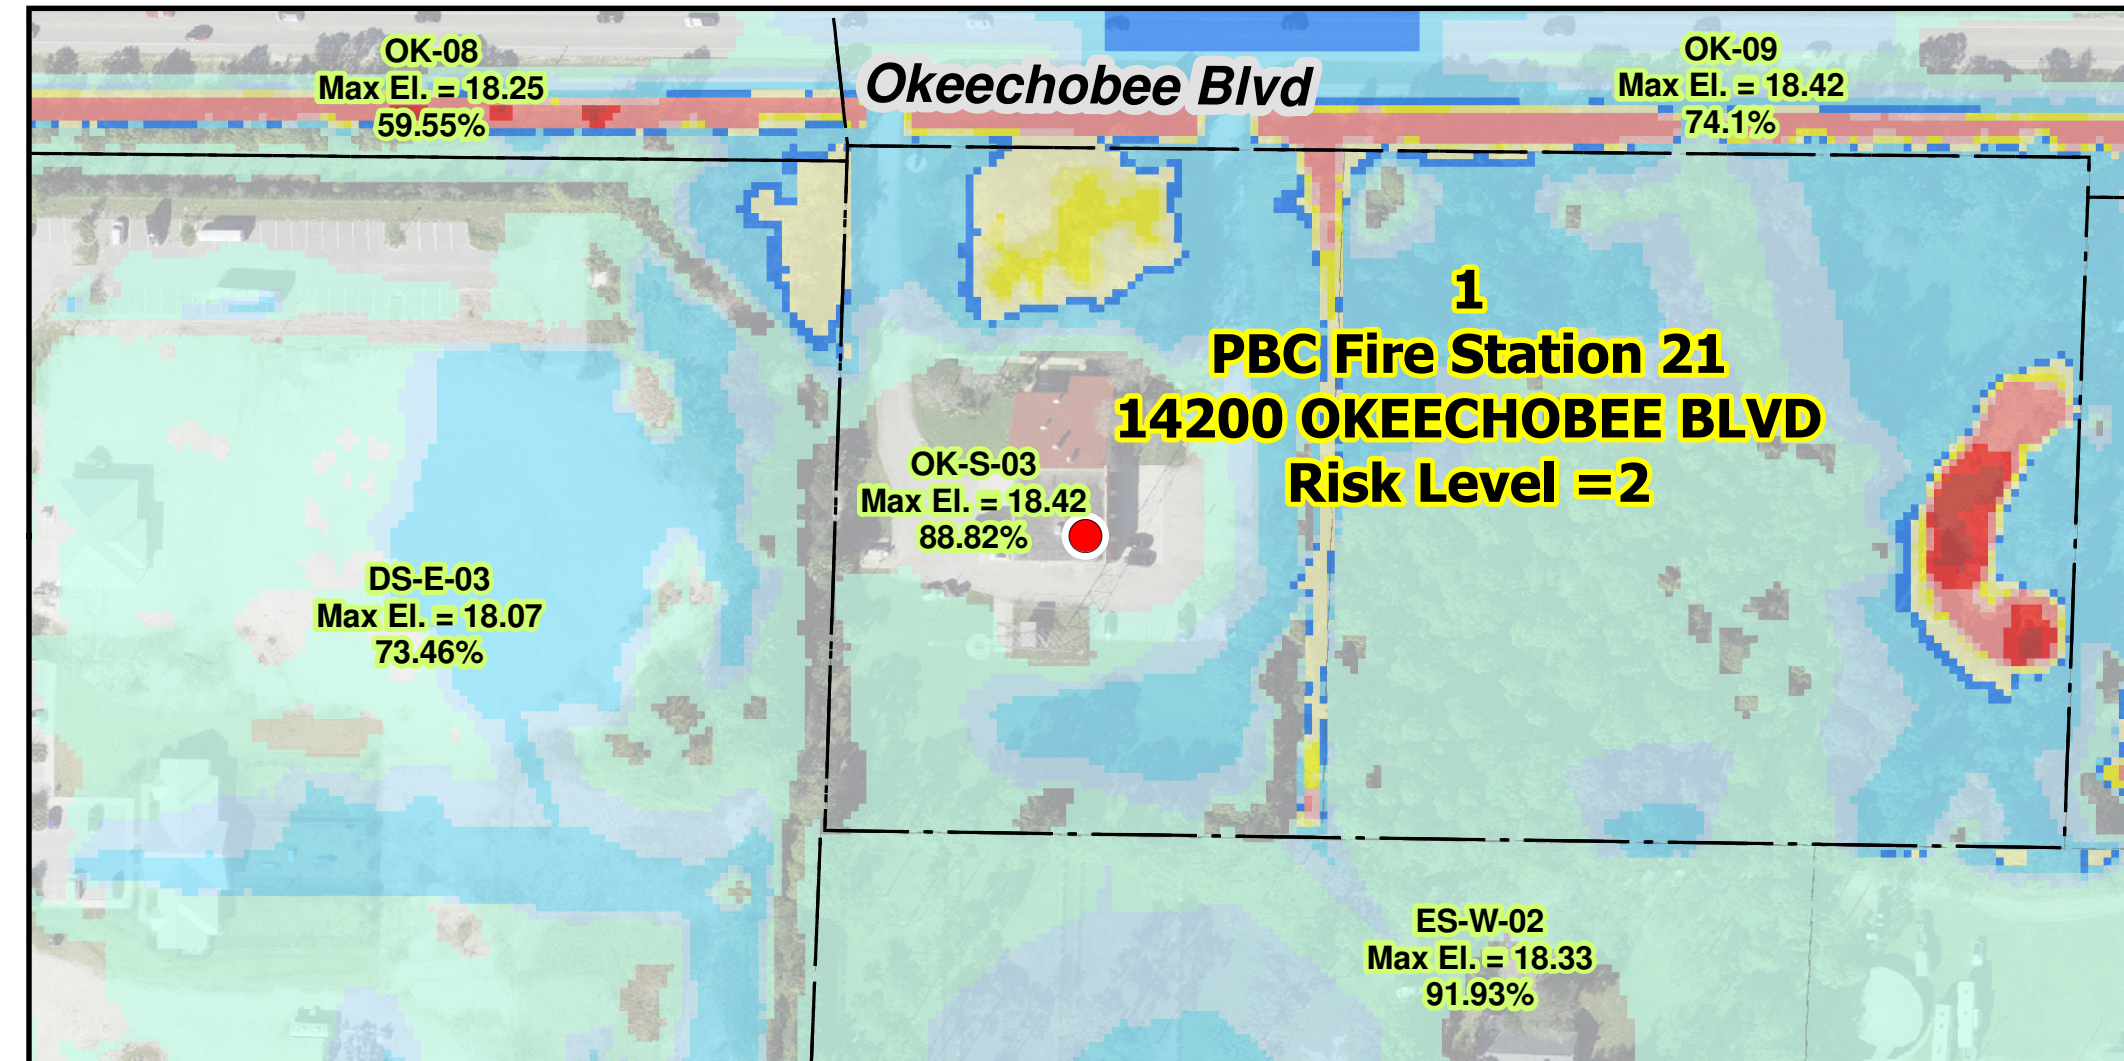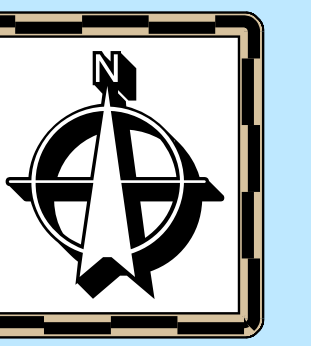

Critical Asset No. 1  
Palm Beach County Fire Station

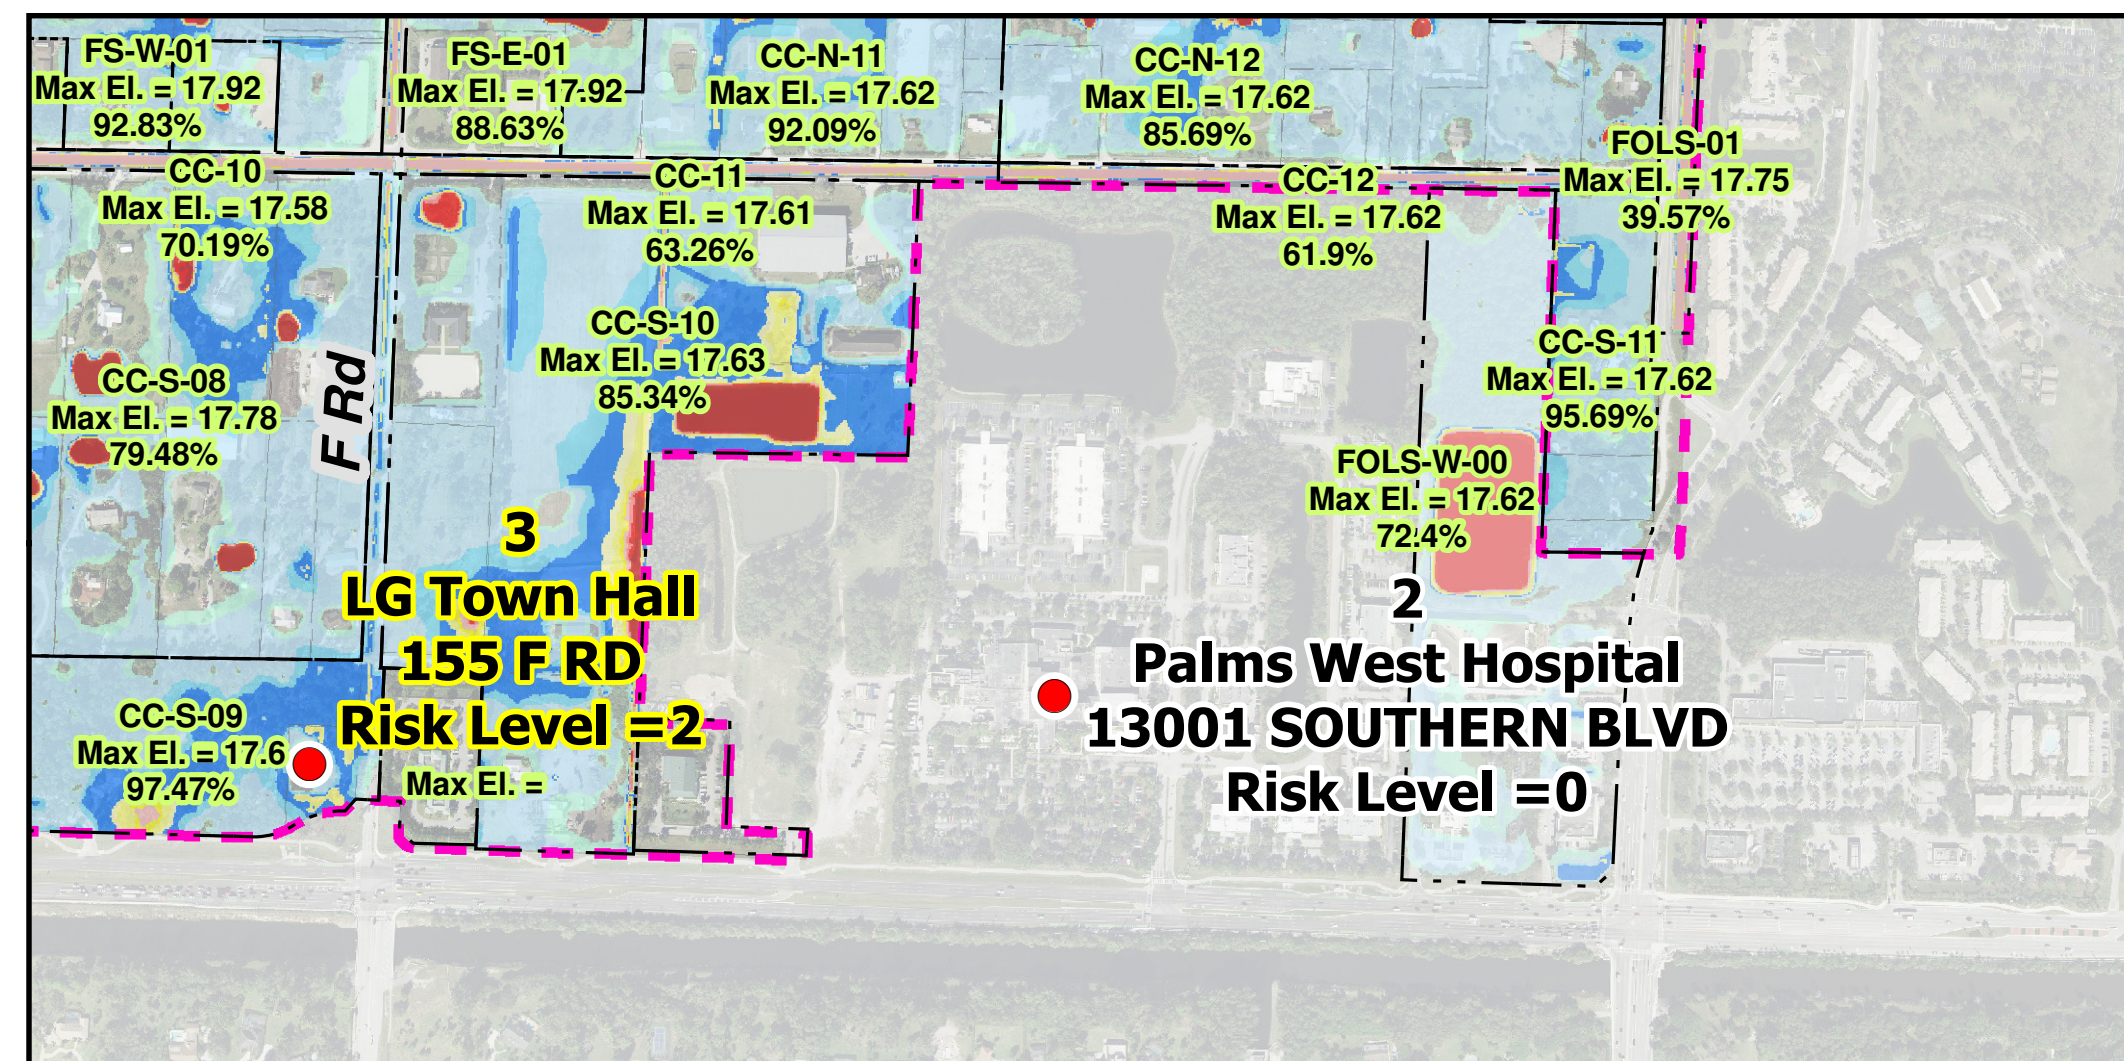


Critical Asset No. 2  
Palms West Hospital

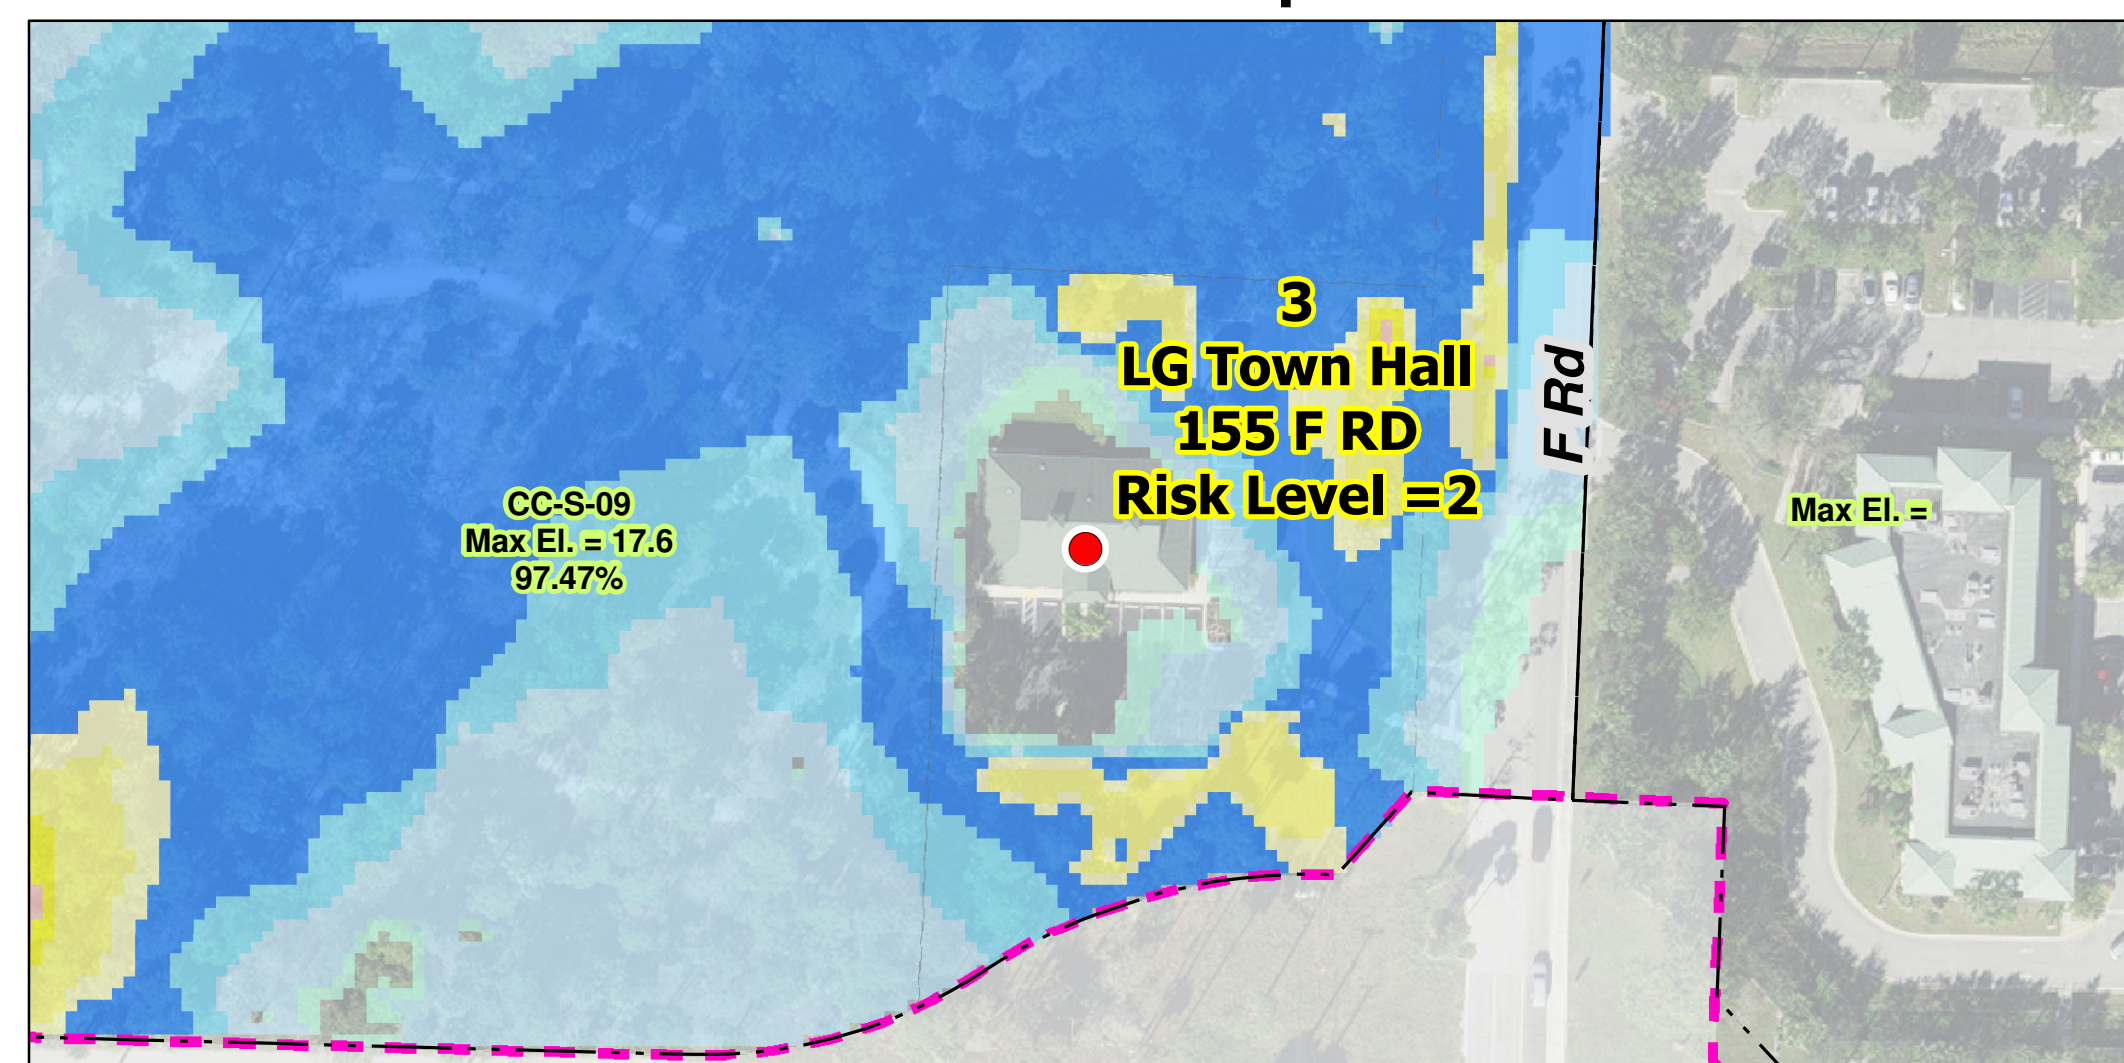


Critical Asset No. 3  
Town Hall




Critical Asset No. 4  
Palm Beach County School Board Communications Tower

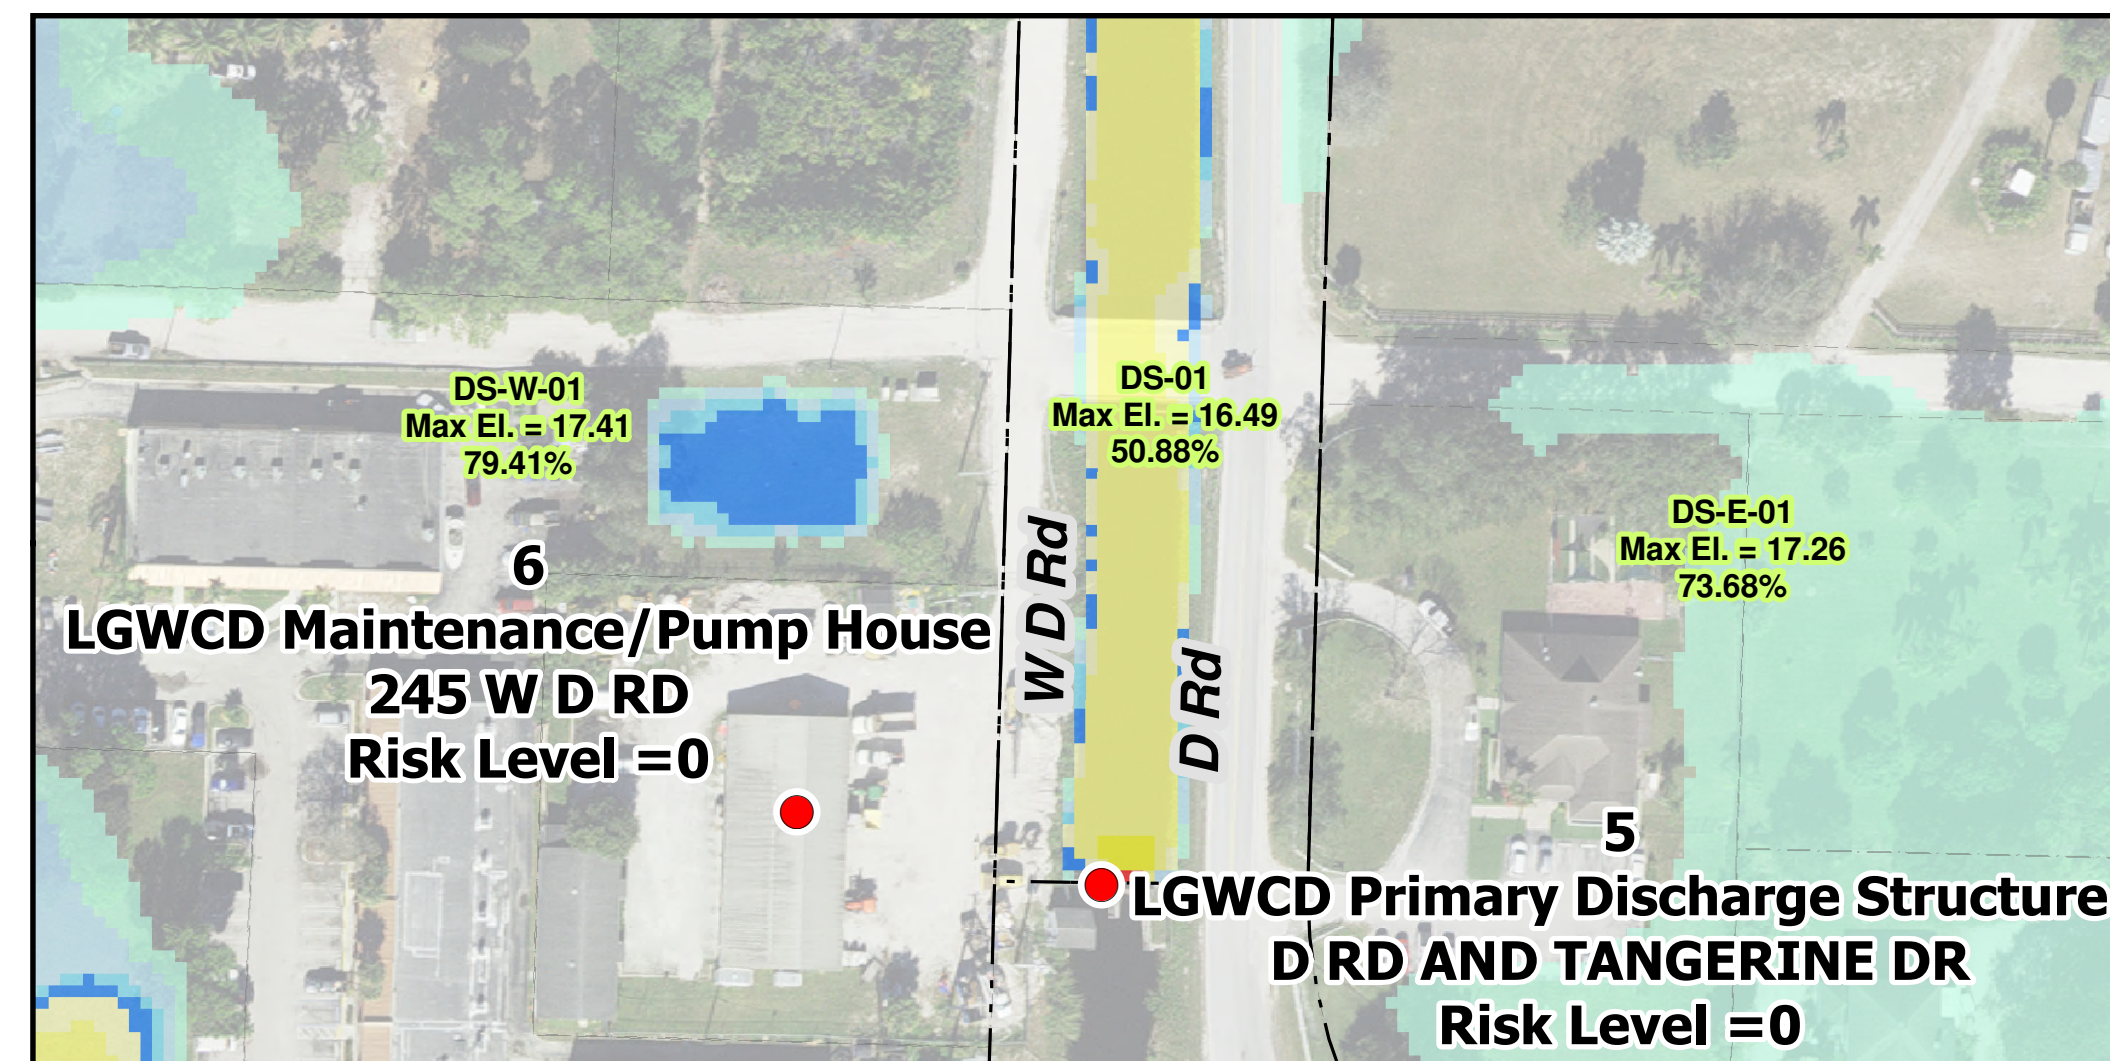


Critical Asset No. 5  
Primary Storm Discharge Structure

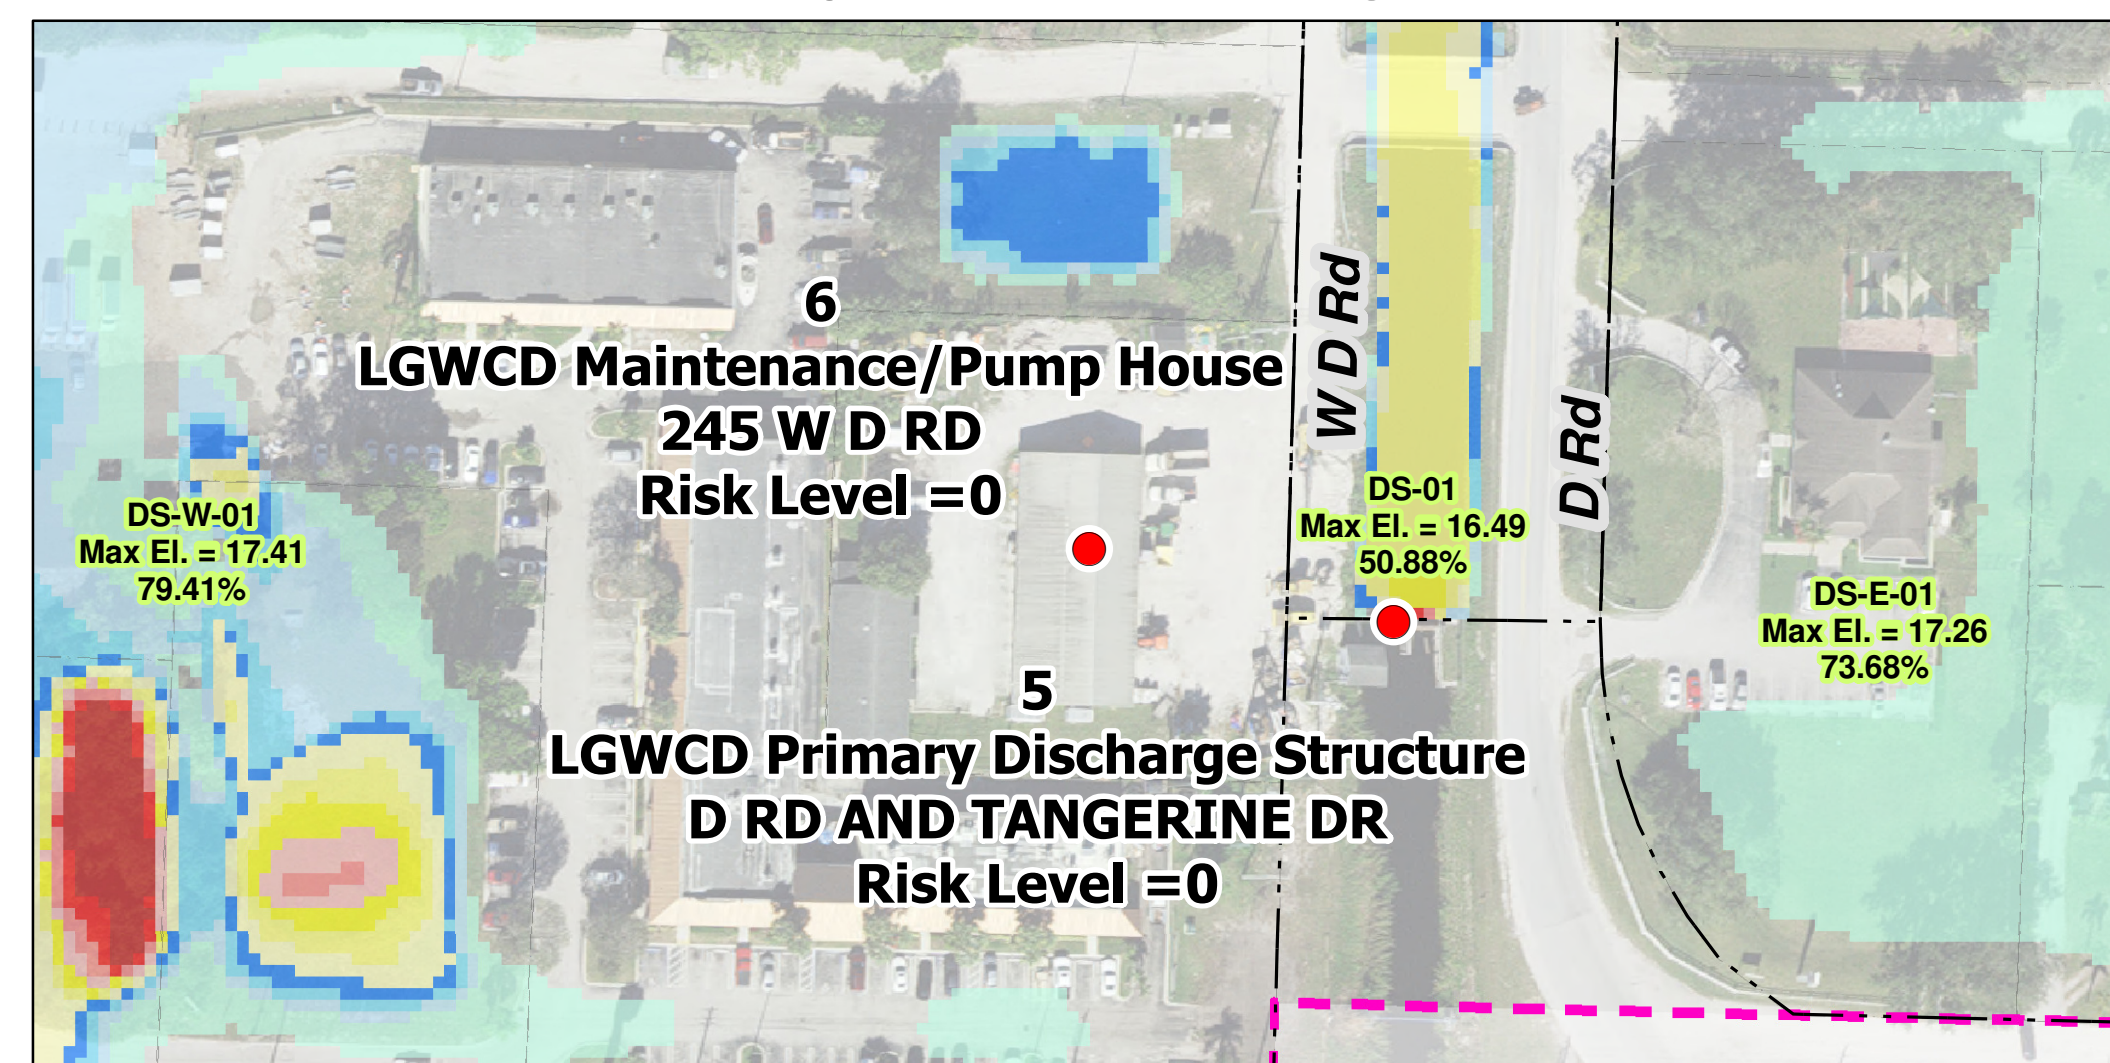


Critical Asset No. 6  
Maintenance Operations Building & Pump House

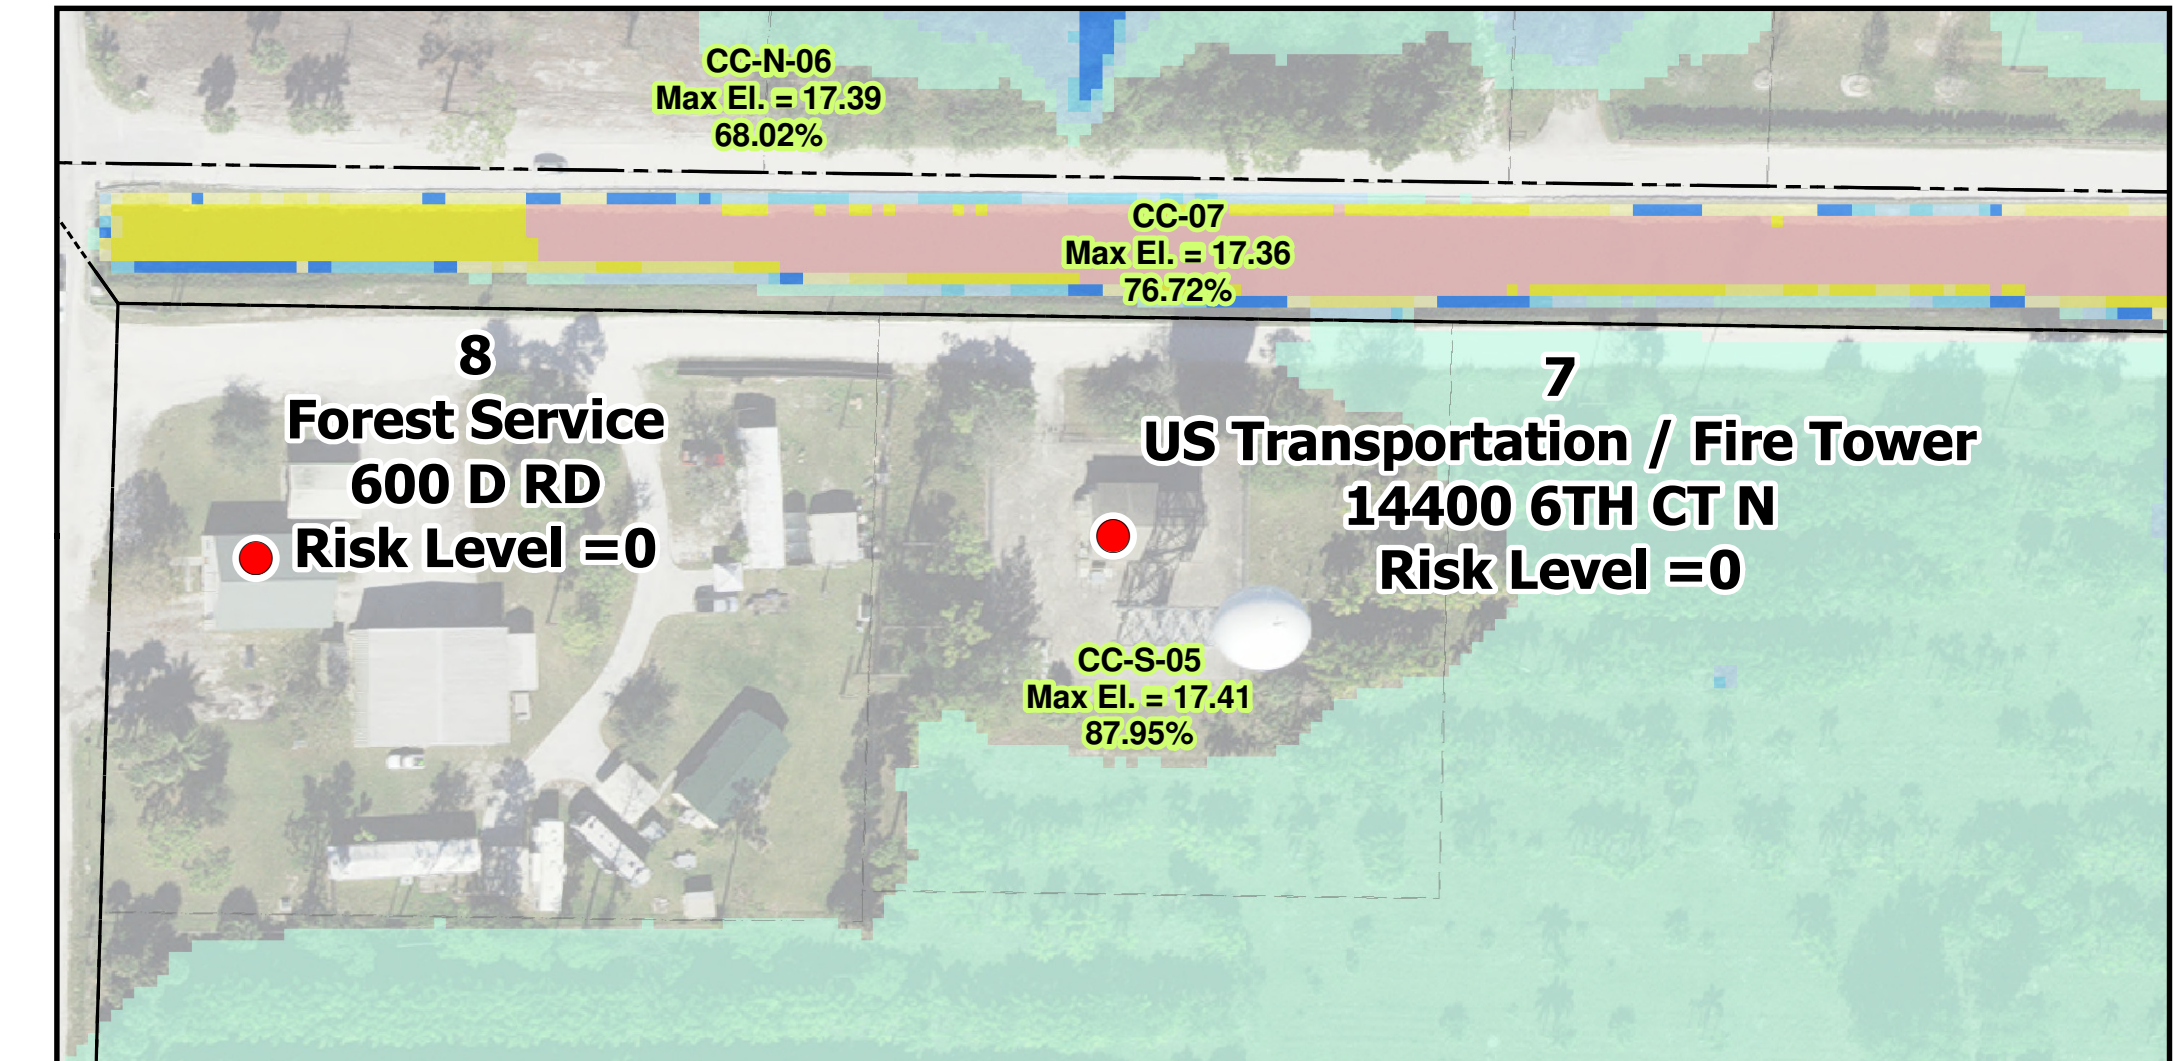

Critical Asset No. 7  
US Department of Transportation / Fire Tower

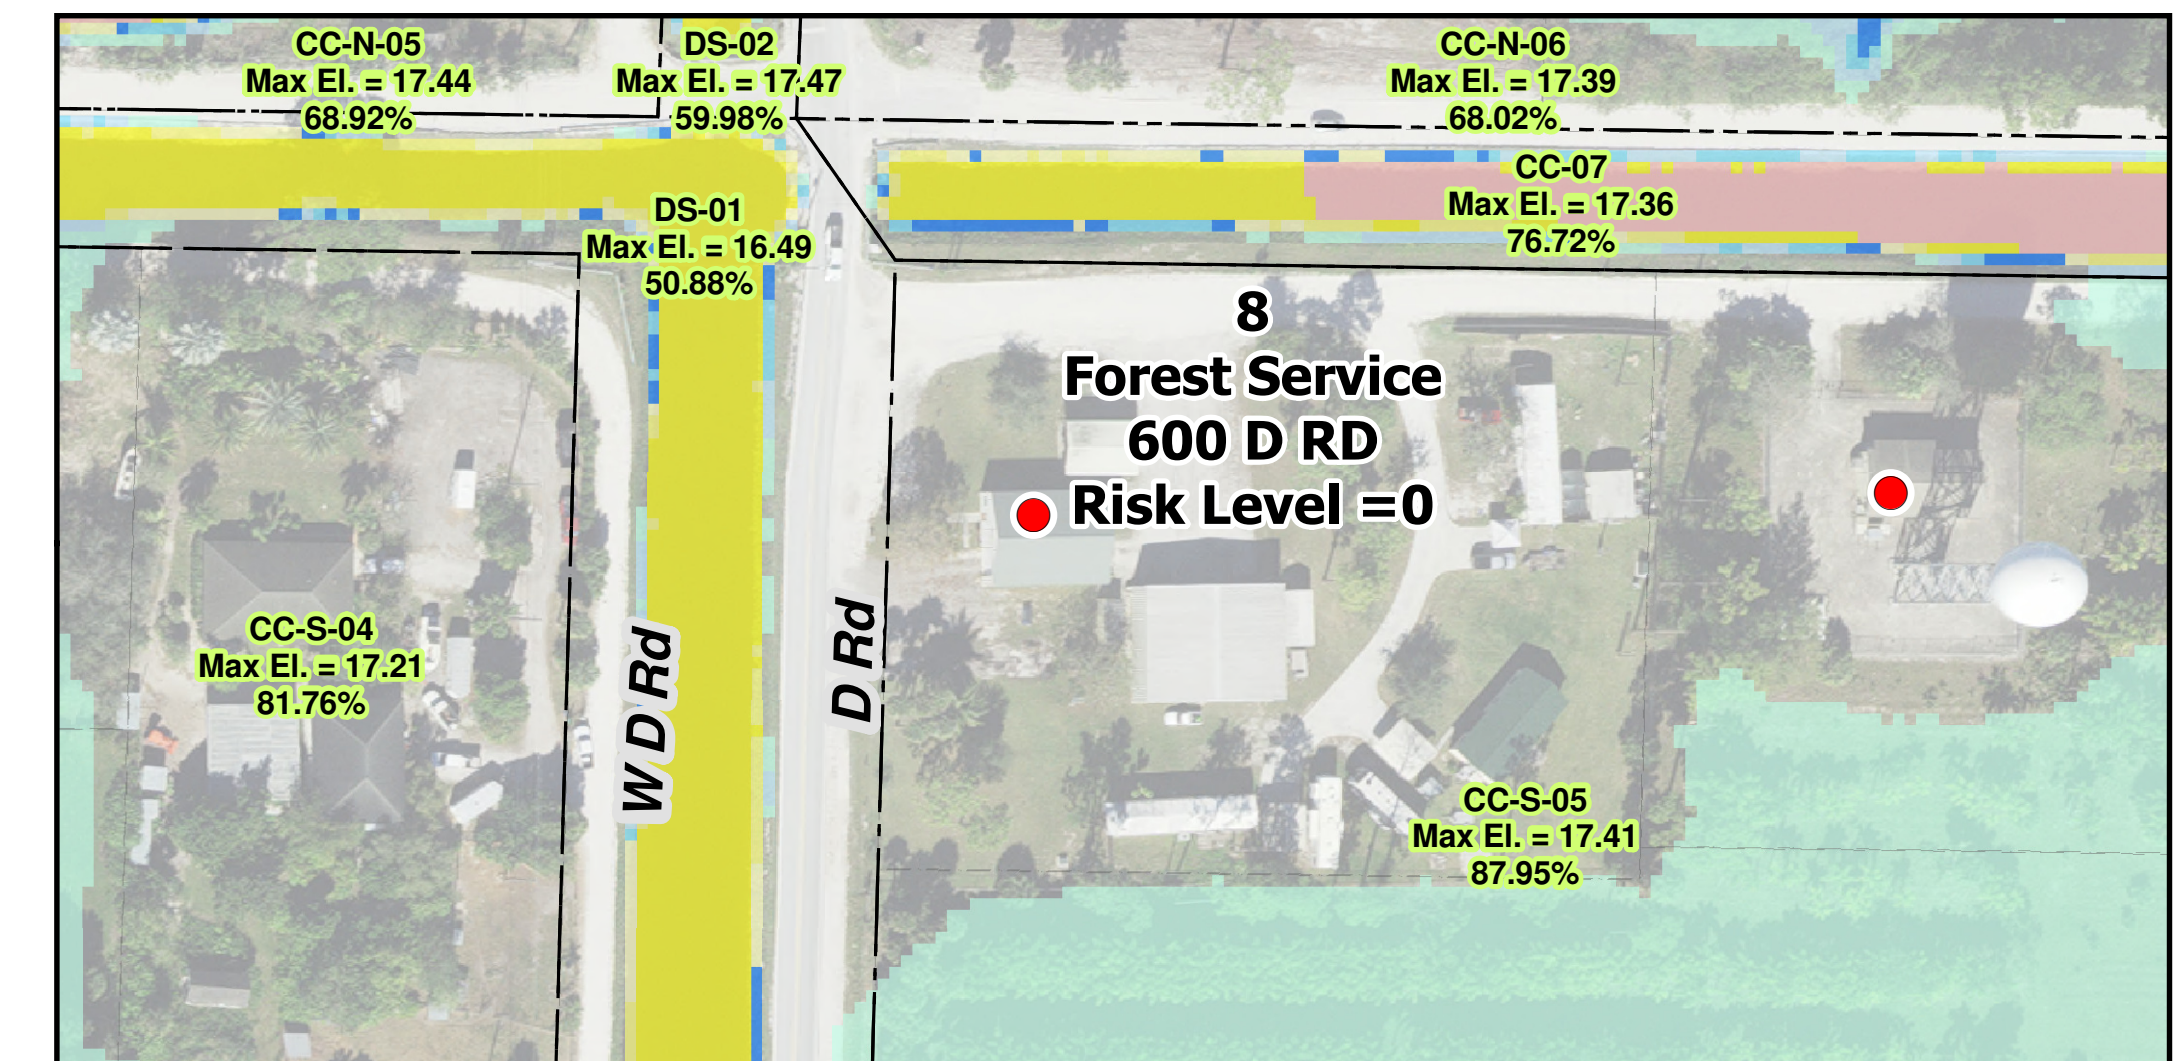

Critical Asset No. 8  
Forest Service

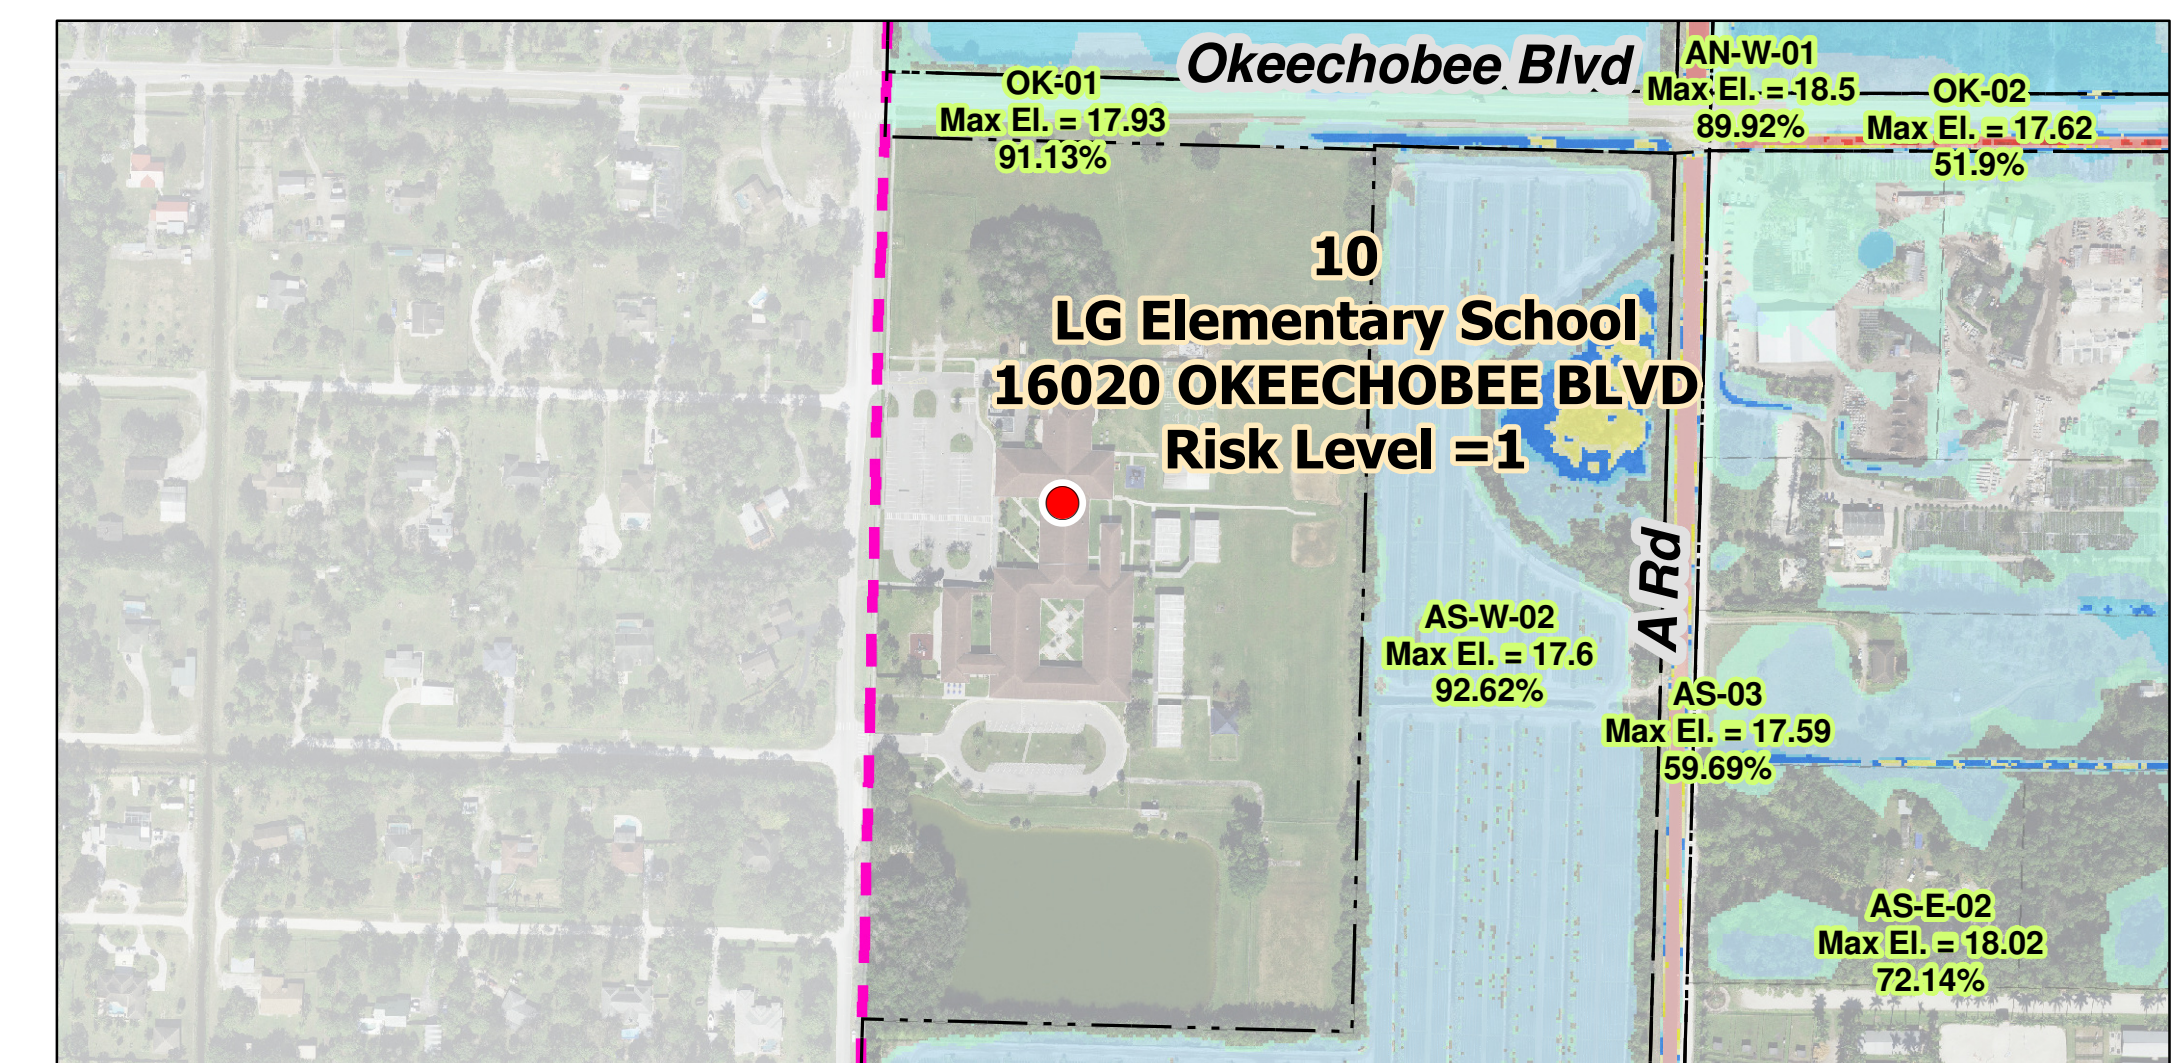

Critical Asset No. 10  
Elementary School

